



Software User Manual

A. Login Procedure

B. Sensor Dashboard (software version 1.5.x)

USER MANUAL

A.	Login procedure iQunet sensor network	4
1.	Install a browser which is supporting WebRTC.....	4
2.	Surf to: connect.iqunet.com	4
3.	Log in with your Google account or create a new account using your email address.	4
4.	Click on “Add Server Node”	5
5.	Enter the Sensor Proxy ID (server-xxxxxxx) and provide an alias name for the server. Click “Save”. The Sensor Proxy ID is provided by iQunet.	5
6.	Click on the created server node to open the iQunet Sensor Dashboard.	6
7.	You are now connected to the iQunet Sensor Dashboard.	6
B.	iQunet Web GUI: Quick Start Guide.....	7
1.	General	7
1.1.	General information pane.....	8
1.2.	Device pane.....	8
1.2.1.	Device pane icons.....	9
1.2.2.	Device pane sensor ordering.....	9
1.3.	Network activity pane	10
2.	General functionality	10
2.1.	Renaming a device	10
2.2.	Deleting a device.....	10
2.3.	Relaying a device via a Repeater or an Actuator	11
3.	Sensor status pane	12
3.1.	Network interface pane sensors	12
3.2.	Network interface pane Base Station	13
3.3.	System information pane battery-powered sensors	14
3.4.	System information pane 24V Powered Vibration Sensor.....	14
3.5.	Auto capture pane	15
3.6.	Sensor control pane	16
3.6.1.	Hall Sensor control (Proximity Sensor).....	16
3.6.2.	Tilt Sensor control (Inclination Sensor)	16
3.6.2.1.	Activation of the roll guard	17
3.6.3.	Reed Sensor control (Proximity Switch Sensor)	18
3.6.4.	Vibration Sensor control	18
3.6.4.1.	Vibration Lab.....	19
3.6.4.1.1.	Invalid data detection	22
3.6.4.2.	Statistics pane.....	22

USER MANUAL

3.6.4.3.	Auto measurement and prefetch explained.....	24
3.6.5.	IEPE Piezoelectric Accelerometer control	27
3.6.6.	Current Clamp control.....	28
3.7.	Content based graph settings	29
4.	Export of data	30
4.1.	Using OPC UA functionality.....	30
4.1.1.	Setting up OPC UA client	31
4.2.	Using Google Sheets Export functionality.....	32
4.3.	Using Data Explorer Export functionality.....	34
4.4.	Using APIs.....	35
4.4.1.	General	35
4.4.2.	Starting with APIs	36
5.	Connection to the iQunet Server	37
5.1.	Hotspot	38
5.1.1.	Connect to hotspot	38
5.1.2.	Turn off hotspot	38
5.2.	Direct Access setup (local access/intranet).....	41
5.3.	WIFI setup	41
5.4.	Hamachi VPN	44
5.5.	Preferred connections of the iQunet Server.....	52
6.	System clock.....	54
7.	Anomaly Monitor	55
8.	System settings	58
8.1.	Suspend measurements.....	59
8.2.	Lock DHCP Address Pool	59
8.3.	Reduce MTU size.....	59

USER MANUAL

A. Login procedure iQunet sensor network

The procedure below describes how to connect to the iQunet sensor network via WebRTC. Check section 5 for other connection possibilities.

1. Install a browser which is supporting WebRTC

iQunet strongly advises to use the Google Chrome browser.

Note: Microsoft will not develop WebRTC for Internet Explorer. Microsoft Edge is WebRTC compatible since it is re-based on Chromium (released January 2020).

WebRTC is an open framework for the web that enables Real Time Communication in the browser. It includes the fundamental building blocks for high quality communications on the web, such as network, audio and video components used in voice and video chat applications. The WebRTC effort is being standardized on an API level at the W3C and at the protocol level at the IETF.

2. Surf to: connect.iqunet.com


3. Log in with your Google account or create a new account using your email address.

This identification is to verify you are not a web robot. Once logged in, you will not be prompted anymore.

The screenshot shows the iQunet login interface. At the top right, there is a 'Login' button circled in red with an arrow pointing to it. Below the header, a message reads: 'Welcome to iQunet Remote Connect! Please login to continue.' The main content area is divided into two sections. The left section is titled 'Sign In with your social account' and features a 'Continue with Google' button. Below this button, it states: 'We won't post to any of your accounts without asking first'. The right section is titled 'Sign in with your email and password' and contains input fields for 'Email' and 'Password', a 'Sign in' button, and a link for 'Forgot your password?'. At the bottom of the right section, it says 'Need an account? Sign up'.

USER MANUAL

- Click on "Add Server Node".

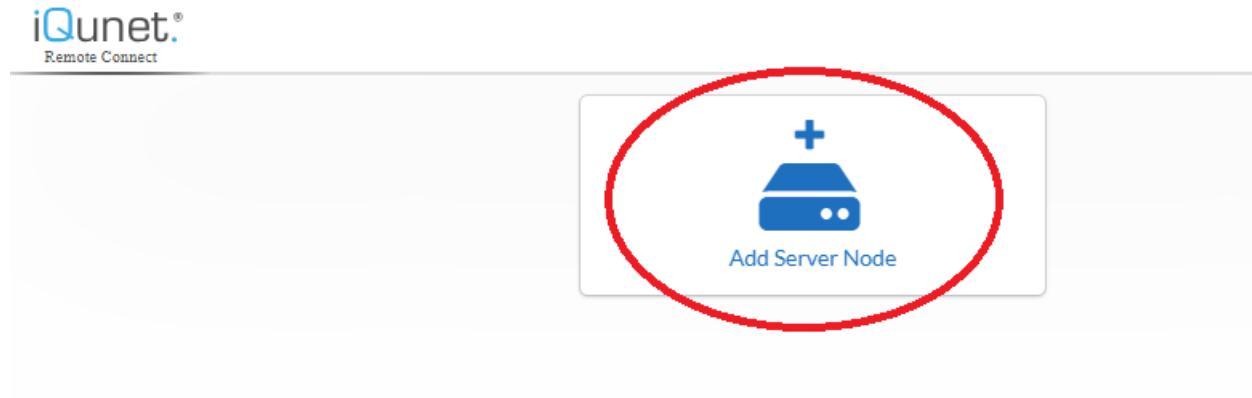

- Enter the Sensor Proxy ID (server-xxxxxxx) and provide an alias name for the server. Click "Save". The Sensor Proxy ID is provided by iQunet.



Add Your Server

Server-xxxxxxx or UUIDv4 *

Alias Name *


Description

Additional Info


or

USER MANUAL

6. Click on the created server node to open the iQunet Sensor Dashboard.

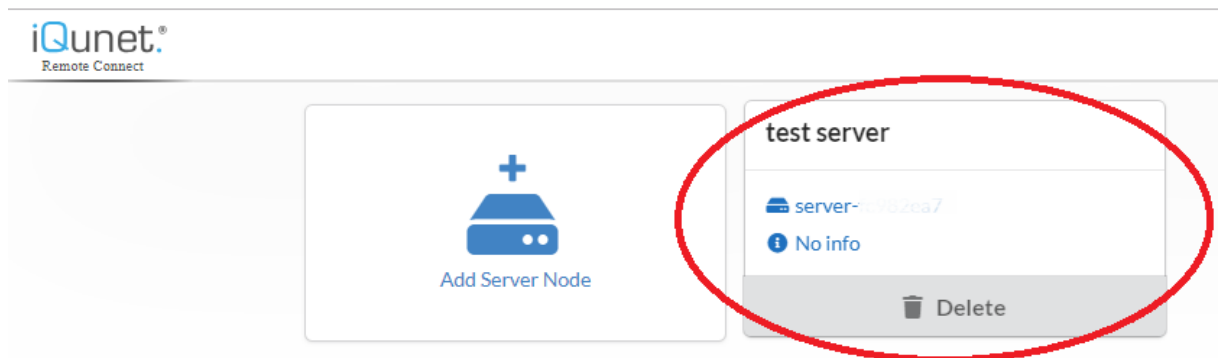

7. You are now connected to the iQunet Sensor Dashboard.

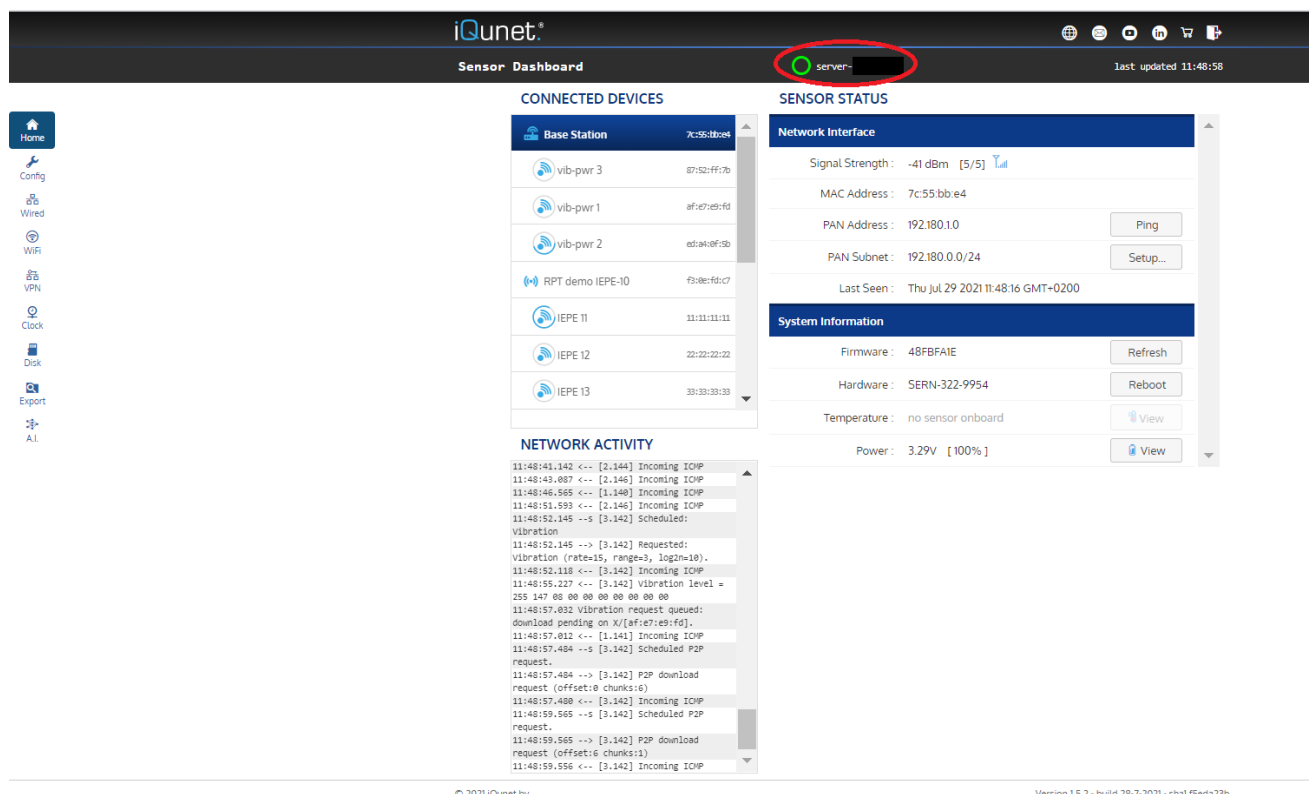

USER MANUAL

B.iQunet Web GUI: Quick Start Guide

1. General

General information pane

Device pane: list of devices connected to the Base Station. Connected devices can be scheduled for periodic measurements or for a single manually triggered measurement.

Network activity pane: this pane shows scrolling logs of sensor activity messages (sent and received messages per sensor).

CONNECTED DEVICES

Device	MAC Address
Base Station	7c:55:bb:e4
vib-pwr 3	87:52:ff:7b
vib-pwr 1	af:e7:e9:fd
vib-pwr 2	ed:a4:8f:5b
RPT demo IEPE-10	f3:0e:fd:c7
IEPE 11	11:11:11:11
IEPE 12	22:22:22:22
IEPE 13	33:33:33:33

SENSOR STATUS

Network Interface

Signal Strength: -41 dBm [5/5]

MAC Address: 7c:55:bb:e4

PAN Address: 192.180.1.0 [Ping]

PAN Subnet: 192.180.0.0/24 [Setup...]

Last Seen: Thu Jul 29 2021 11:48:16 GMT+0200

System Information

Firmware: 48FBFAIE [Refresh]

Hardware: SERN-322-9954 [Reboot]

Temperature: no sensor onboard [View]

Power: 3.29V [100%] [View]

NETWORK ACTIVITY

```

11:48:41.142 <-- [2.144] Incoming ICMP
11:48:43.087 <-- [2.146] Incoming ICMP
11:48:46.565 <-- [1.140] Incoming ICMP
11:48:51.593 <-- [2.146] Incoming ICMP
11:48:52.145 --s [3.142] Scheduled:
Vibration
11:48:52.145 --> [3.142] Requested:
Vibration (rate=15, range=3, log2n=10).
11:48:52.118 <-- [3.142] Incoming ICMP
11:48:55.227 <-- [3.142] Vibration level =
255 147 08 00 00 00 00 00 00
11:48:57.032 Vibration request queued:
download pending on X/[af:e7:e9:fd].
11:48:57.012 <-- [1.141] Incoming ICMP
11:48:57.484 --s [3.142] Scheduled P2P
request.
11:48:57.484 --> [3.142] P2P download
request (offset:0 chunks:6)
11:48:57.480 <-- [3.142] Incoming ICMP
11:48:59.565 --s [3.142] Scheduled P2P
request.
11:48:59.565 --> [3.142] P2P download
request (offset:6 chunks:1)
11:48:59.556 <-- [3.142] Incoming ICMP
    
```

Sensor status pane: this dynamic pane shows sensor status and device depending information and settings.

USER MANUAL

1.1. General information pane

The screenshot shows the iQunet Sensor Dashboard. At the top, there is a header with the iQunet logo and several icons. Below the header, the text "Sensor Dashboard" is displayed. To the right, there is a status bar showing "server~" with a green circle icon and "last updated 09:47:31".

Callouts provide the following information:

- Connection status to the iQunet Server from sensor network.**
 - Green: connected
 - Red: connection lost
 - Grey: connecting
- Connected server**
- Time stamp of last screen refresh**

1.2. Device pane

The screenshot shows the "CONNECTED DEVICES" pane. It contains a list of devices with their names and MAC addresses. The devices are: Base Station (7c:55:bb:e4), vib-pwr 3 (87:52:ff:7b), vib-pwr 1 (af:e7:e9:fd), vib-pwr 2 (ed:a4:0f:5b), RPT demo IEPE-10 (f3:0e:fd:c7), IEPE 11 (11:11:11:11), IEPE 12 (22:22:22:22), and IEPE 13 (33:33:33:33). Each device has a circular icon next to its name.

Callouts provide the following information:

- Devices connected to the Base Station.** Once seen by the Base Station, the list remains intact until the device is deleted. Devices losing contact with the Base Station will show no updated network status (see Sensor Status pane) but remain linked with the Base Station (and remain in the list).
- The circles around the sensor icons represent a countdown to the next scheduled measurement.** When the blue circle becomes completely gray, a new measurement will be started. These circles only appear for devices currently activated for measuring and sending data on preset time intervals.
- When this icon appears, the measurement is being downloaded from the sensor and sent to OPC.**

USER MANUAL

1.2.1. Device pane icons


The icons in front of the sensor name provide you with more information regarding the sensor status.

Icon	Explanation
	The sensor is active (normal sensor operation).
	The sensor is active, and a sensor measurement is requested.
	The measurement is being downloaded from the sensor device and sent to OPC.
	The sensor is last seen more than 10 minutes ago by the iQunet Server.
	The connection of the sensor to the iQunet Server is pending. The sensor has been seen by the Base Station/Repeater connected to the Server but has not been assigned yet. By (re)naming the sensor (see section 2.1 for instructions), the sensor will become connected to the Base Station/Repeater. If the sensor connection is still pending after 10 minutes, the sensor will be rebooted so it can reconnect itself to its original Base Station/Repeater and corresponding Server where it received a name previously.
	The connection of the sensor to the iQunet Server is pending. The sensor has been seen by the Base Station/Repeater connected to the Server but the sensor itself is not active anymore (last seen more than 10 minutes ago). The sensor can be deleted from the "Connected Devices" list if it is not relevant anymore (see section 2.2).
	The subnet of the Base Station has been changed (see section 3.2) and therefore the sensor is now registered in another subnet.

Remark: it can be necessary to refresh the Sensor Dashboard to see the latest sensor status (blue, grey...).

1.2.2. Device pane sensor ordering

The sensors are listed in the following order in the device pane (inside the different groups the sensors are sorted according to sensor mac ID number (00:00:00:00 to ff:ff:ff:ff)):

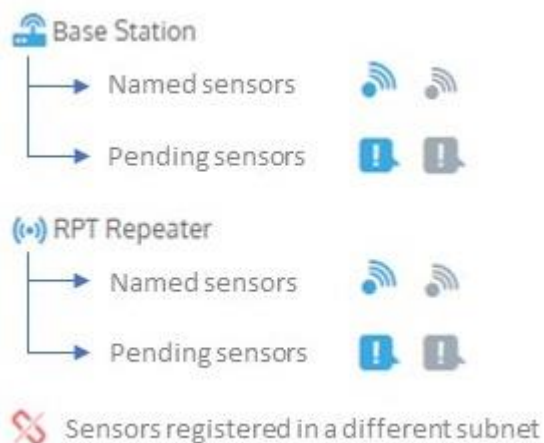

USER MANUAL

1.3. Network activity pane

NETWORK ACTIVITY

This pane shows scrolling logs of sensor network messages.

"<- -<": incoming messages from connected sensor devices (seen sensors)

"- ->": outgoing messages to the sensor devices (will be received as soon as sensor is awake)

```
15:00:51.554 <- [1.143] Incoming ICMP
15:00:58.287 <- [1.140] Incoming ICMP
15:01:11.241 <- [1.142] Incoming ICMP
15:01:19.419 <- [1.143] Incoming ICMP
15:02:00.357 <- [1.140] Incoming ICMP
15:02:01.960 <- [1.143] Incoming ICMP
15:02:14.889 <- [1.142] Incoming ICMP
15:03:02.447 <- [1.140] Incoming ICMP
15:03:05.532 <- [1.143] Incoming ICMP
15:03:18.497 <- [1.142] Incoming ICMP
15:03:49.741 -> [1.140] Scheduled core status request.
15:03:53.536 -> [1.140] Scheduled vibration request.
```

2. General functionality

2.1. Renaming a device

By pressing the icon, a popup appears. The device can be renamed.


Device
2f:d7:25:8d

Edit Device Tag

Tag for [2f:d7:25:8d]

Rename

Cancel

The devices MAC address cannot be altered and remains unique.

2.2. Deleting a device

By pressing the icon, a popup appears. The device can be deleted by renaming it to "delete".


Device
2f:d7:25:8d

Edit Device Tag

Tag for [2f:d7:25:8d]

Rename

Cancel



When deleted, the device will be removed from the sensor list. As soon as the battery is activated in the device, the device pops up again in the list and is automatically connected to the closest Base Station in the field when in reach.

USER MANUAL


2.3. Relaying a device via a Repeater or an Actuator

Remark: iQunet recommends not to use the relaying with the VIA keyword but rather let the sensors decide automatically for themselves to which Base Station or Repeater they want to connect in function of the signal strength.

To relay sensors via a Repeater or Actuator, simply rename the Repeater or Actuator and start the name with "RPT". The name of the Repeater or Actuator may NOT contain spaces.

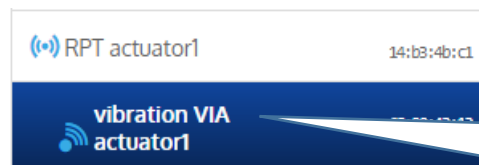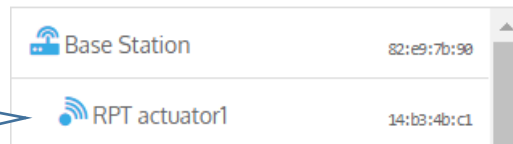

To force the relay of a sensor device via a Repeater or Actuator, type "VIA" after the device name followed by the Repeater or Actuator name.

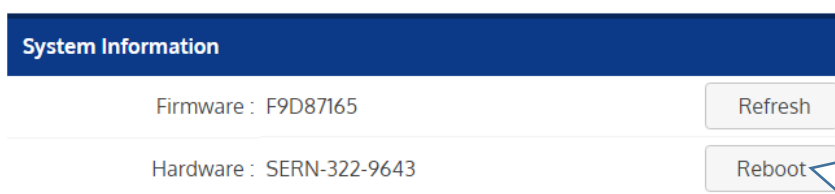

In the device pane select each device involved in the relaying (Repeater, Actuator and sensors), and press "Reboot" for each of them.

Network Interface

Signal Strength : -54 dBm [5/5]

MAC Address : 68:90:43:13

PAN Address : 192.168.2.140

Ping

WakeUp Interval : 60 sec

Last Seen : Mon Mar 04 2019 12:19:50 GMT+0100

By clicking on each device, check if each Repeater or Actuator has received a new subnet like "192.168.2.xxx", "192.168.3.xxx", etc. In this example, sensor 68:90:43:13 is fixed relayed via Actuator "RPT actuator1" under the subnet "192.168.2".

USER MANUAL

3. Sensor status pane

3.1. Network interface pane sensors

Network Interface pane is showing current interface settings from selected device.

Signal strength: current wireless signal strength between device and Base Station (or Repeater).

When connected, the device receives a unique PAN address. This address is used in the network activity log. Ping to check network activity.

Sensors last network contact

SENSOR STATUS

Network Interface

Signal Strength : -93 dBm [2/5] 

MAC Address : 2f:d7:25:8d

PAN Address : 192.168.1.140 Ping

WakeUp Interval : 60 sec ▼

Last Seen : Fri Feb 02 2018 18:42:37 GMT+0100

System Information

Firmware : 0407830E Refresh

Hardware : SERN-322-9943 Reboot

Temperature : 5.7 °C  View

Power : 2.74V [83%]  View

MAC address: the devices unique number. This number is printed on the device itself.

Device wakeup interval: the device will be in iQunet sleep mode for the set time. It will become active at the end of the set time interval. Change interval by changing the number.

USER MANUAL

3.2. Network interface pane Base Station

SENSOR STATUS

Network Interface

Signal Strength: -114 dBm [0/5] 

MAC Address: 82:e9:7b:90

PAN Address: 192.168.1.0

PAN Subnet: 192.168.0.0/24

Last Seen: Mon Mar 04 2019 11:10:22 GMT+0100

Ping

Setup...

System Information

Firmware: B36B79C1

Refresh

Hardware: SERN-322-9953

Reboot

Temperature: no sensor onboard

 View

Power: 3.25V [100%]

 View

Edit PAN Subnet

Enter class C network:

 . . . The subnet mask has the following form:
e.g. 192.168.0.0

Please note: The base station will restart and registered devices will be disconnected. You can revert to the original mask at a later time to communicate with those devices.

Change

Cancel

System Information

Firmware: B36B79C1

Refresh

Hardware: SERN-322-9943

Reboot

Temperature: 18.5 °C

 View

Power: 2.93V [81%]

 View

MAC address: the device's unique number. This number is printed on the device itself.

When 2 Servers are using the same PAN subnet, you can change the subnet of the Base Station.

Fill out a different subnet (e.g. 192.169.0.0) and click Change.

Select each device involved in the relaying and press Reboot for each of them. If sensors are connected to the wrong server, you can reboot them from the other server or reinsert the batteries while they are close to the intended server's Base Station.

Remark: a sensor can become "blacklisted" (see the Network Activity pane (section 1.3)) if the sensor continuously jumps back and forth between two Base Stations (2 Base Stations have the same subnet). In this case it is recommended to change the subnet of one of the Base Stations.

USER MANUAL

3.3. System information pane battery-powered sensors

System Information pane is showing the current connected device information.

Firmware: current firmware version running on selected sensor device.

Board temperature of the sensor device (when available). Pressing "View" will generate a graph over time. Data points correspond to each System Information inquiry by clicking on the device in the device pane on the left.

SENSOR STATUS

Network Interface

Signal Strength : -93 dBm [2/5]

MAC Address : 2f:d7:25:8d

PAN Address : 192.168.1.140 Ping

WakeUp Interval : 60 sec ▼

Last Seen : Fri Feb 02 2018 18:42:37 GMT+0100

System Information

Firmware : 0407830E Refresh

Hardware : SERN-322-9943 Reboot

Temperature : 5.7 °C View

Power : 2.74V [83%] View

Current hardware version of the selected sensor device. Pressing "Reboot" resets the hardware. This is equivalent to removing and re-installing batteries.

Status of the batteries, with indication of remaining charge of the batteries. Pressing "View" will generate a graph over time. Data points correspond to each System Information inquiry by clicking on the device in the device pane on the left.

3.4. System information pane 24V Powered Vibration Sensor

The iQunet wireless 24V Powered Vibration Sensor is powered with a 24V power supply (6VDC-60VDC). The sensor also has 1 standard coin cell on board acting as a backup during short power interruptions.

Firmware: current firmware version running on selected sensor device.

Board temperature of the sensor device (when available). Pressing "View" will generate a graph over time. Data points correspond to each System Information inquiry by clicking on the device in the device pane on the left.

System Information

Firmware : 95C7722F Refresh

Hardware : SERN-322-9945 Reboot

Temperature : 10.8 °C View

Power : 3.29V 3.14V [100%] View

Current hardware version of the selected sensor device. Pressing "Reboot" resets the hardware.

Power status, with indication of remaining charge of the back-up batterie. Pressing "View" will generate a graph over time of the battery voltage level and the external power supply level (chip only measures up to 3.3V). Data points correspond to each System Information inquiry by clicking on the device in the device pane on the left.

USER MANUAL

3.5. Auto capture pane

For the event-based sensors (the 24V Powered Vibration Sensor, the Current Clamp and the IEPE Accelerometer), it is possible to change the capture mode from "Peak" (measurement with the highest peak power during the set time interval is saved) to "Instant" (measurement is taken at the end of the set measurement interval).

Select the queue interval in the dial pane. First select the hours by dragging the clock pointer over the desired number. Then repeat this action for selecting the minutes. The device will now become active after the set interval.



A sensor device which is enabled for Auto Capture will show this extra pane. To start the periodic sensor measurements, slide the button to blue. The queue interval can now be set.

CONNECTED DEVICES

Base Station	7c:55:bb:e4
vib-pwr 3	87:52:ff:7b
vib-pwr 1	af:e7:e9:fd
vib-pwr 2	ed:a4:0f:5b

Devices activated for automatic measurements will now show a countdown circle around the sensor icon.

Remark: for the event-based sensors (the wireless 24V Powered Vibration Sensor, the Current Clamp, the IEPE Accelerometer and the MAD Vibration Sensor) the set auto measurement queue interval is also the measurement interval since these sensors will capture vibration or current signals from the moment a measurement is started until a new measurement is started (when used in the "Peak" capture mode).

USER MANUAL

3.6. Sensor control pane

3.6.1. Hall Sensor control (Proximity Sensor)

Pane appears when selecting a sensor device with a Hall Sensor on board.

The sensor device can be triggered to start measurements as soon as the device is awake (see wakeup interval). Clicking "Force" starts the burst of measurements. "Stop" will interrupt the measurements triggered earlier.

Hall Sensor Control

Trigger Sensor :

Hall :

Field values are combined with the measuring voltage at that time (for calibration purposes). The burst of measurements can be viewed in a graph by pressing "View".

3.6.2. Tilt Sensor control (Inclination Sensor)

Pane appears when selecting a sensor device with a Tilt Sensor on board.

Maximum allowed roll before initiating an alarm. If the set value is surpassed, the connected Actuator device will be triggered.

Tilt Sensor Control

Guard Roll :

Burst Samples :

Activity Level :

Position :

Trigger Sensor :

Select the number of samples in a measurement burst.

Required activity level to wake up the sensor.

The sensor device can be triggered to start measurements as soon as the device is awake (see wakeup interval). Clicking "Force" starts the burst of measurements. The measurement will stop after the chosen number of burst samples.

When active, Roll and Pitch values are visualized. The recorded burst of measurements can be viewed in a graph by pressing "View".

USER MANUAL

3.6.2.1. Activation of the roll guard

The guard of the inclination roll parameter works instantaneously in combination with the Actuator. For the Actuator to enter the standby mode for the roll guard, the Inclination Sensor needs to make a measurement first (click “Force”). This is the same whether the Actuator works as a repeater or not.

To check this functionality, you can perform the following test (if possible, perform the test on a table first).

Remark: make sure to perform this test only when the Actuator is connected to the mains otherwise the UPS function will start working and the batteries will drain.

- Connect the Actuator to the mains with the USB charger. It is not necessary to insert the batteries.
- Place your multimeter in the outside front contact of the Actuator and measure the resistance. You will detect a normal closed contact when the Actuator is on.
- Insert the batteries into the Inclination Sensor. The sensor will wake up (check the messages in the network activity pane). The “device” will appear in the device list. Keep the sensor values as set initially.
- Click “Force”. The Inclination Sensor will start measuring within 60 seconds (the wake-up interval as set in the sensor information pane on the top). You can lower the wake-up interval setting but this is not necessary since it will take some time before the sensor learns to wake up every 3 seconds effectively for example.
- Make some roll and pitch movements with the Inclination Sensor. The sensor will show changing values in the two “position” fields in the Sensor Dashboard. After measuring the set number of samples (e.g. 32), the sensor has proven to be active and is now armed to guard the roll of the sensor.
- Roll the sensor over the set guard roll angle (positive or negative). The message “actuator message 01” will appear in the network activity pane. The Actuator is then switching the contact to open (see the readings on your multimeter).
- Return the sensor to a safe position after 10 to 30 seconds. The sensor will send the “actuator message 00” to inform the Actuator that everything is safe again. The Actuator contact will be closed again.

The guard of the roll angle is always on, even if the Inclination Sensor looks asleep. There is no need to trigger the sensor again. In this way there will be little use of the batteries.

Note that the Inclination Sensor is optimized to be mounted on vibration machinery. A minimum vibration level is needed to keep the sensor awake internally. If the sensor doesn’t detect any vibration, the machinery is assumed to be not active, and the sensor will go in ultra-deep sleep mode. As soon as there is a minimum activity (see the set activity level), the sensor will switch on. Setting the activity level to none will prevent the sensor from going to deep sleep mode. The sensor will then always be active, even at night or when not in use. This will use unnecessary battery lifetime. The sensor batteries will drain quickly in this case.

USER MANUAL

3.6.3. Reed Sensor control (Proximity Switch Sensor)

Pane appears when selecting a sensor device with a Reed Sensor on board.

The sensor device can be triggered to start measurements as soon as the device is awake (see wakeup interval). Clicking "Force" starts the burst of measurements. "Stop" will interrupt the measurements triggered earlier.

Reed Sensor Control

Trigger Sensor : Force
Stop

Count : 0001423099 pulses (5 hours ago) View

RPM : 0736 (5 hours ago) View

The number of magnetic pulses is counted continuously. When the sensor is active, pulses are shown in this field. The counts are shown in a graph by pressing "View".

Revolutions per minute value based on the count of magnetic pulses. When the sensor is active, rpm values are shown in this field. The rpm values are shown in a graph by pressing "View".

3.6.4. Vibration Sensor control

Pane appears when selecting a sensor device with an Acceleration Sensor on board.

Select the sampling rate.

Select the number of samples.

By pressing "REC", the vibration measurement is triggered with the set parameters.

Select a number of samples to make an antecedent RMS calculation for the vibration measurements. If the RMS value is below threshold, the full sensor download is aborted (see 3.6.4.3).

Progress of automatic download

Measurement Setup

Rate : 3200Hz
Axis : XYZ

Samples : n = 1024
Range : 2G

Capture : REC
Level :

Measurement Download

Info Prefetch : n = 128
Highpass : 6Hz

Download :
Threshold : none

Select 1, 2, or 3 measurement axes in the dropdown menu.

Select the desired dynamic range of the sensor in the dropdown menu. Check the RMS values of the last month in the Statistics pane (see section 3.6.4.2) to find out which range is best suited. Keep the range as low as possible for optimal accuracy.

Check if vibration level is high enough for download (see section 3.6.4.3).

Select the high pass cut off frequency to remove the DC component and the low frequency noise in the RMS signal. See section 3.6.4.3 for more information.

A full measurement is downloaded when the RMS is above threshold. See section 3.6.4.3.

USER MANUAL


3.6.4.1. Vibration Lab

Vibration Lab pane shows basic analysis of measured vibration signals.

Measurements saved in the iQunet OPC historian. Click on the date to see the available measurements.

Time Series box: selecting 1 measurement in this box will show the respective time series graph. Select multiple time signals by dragging the mouse pointer. Click "Freq" to add the selected measurements to the box on the right. When only 1 measurement is selected, clicking "Freq" will automatically show the spectrum plot. Click "Bulk" to add all measurements to the box on the right.

Spectrum box: select 1 measurement to show the spectrum of this measurement. Drag over the list to select multiple items for removing them back to the left box (click "Time"). Click "None" to remove all measurements in this box.

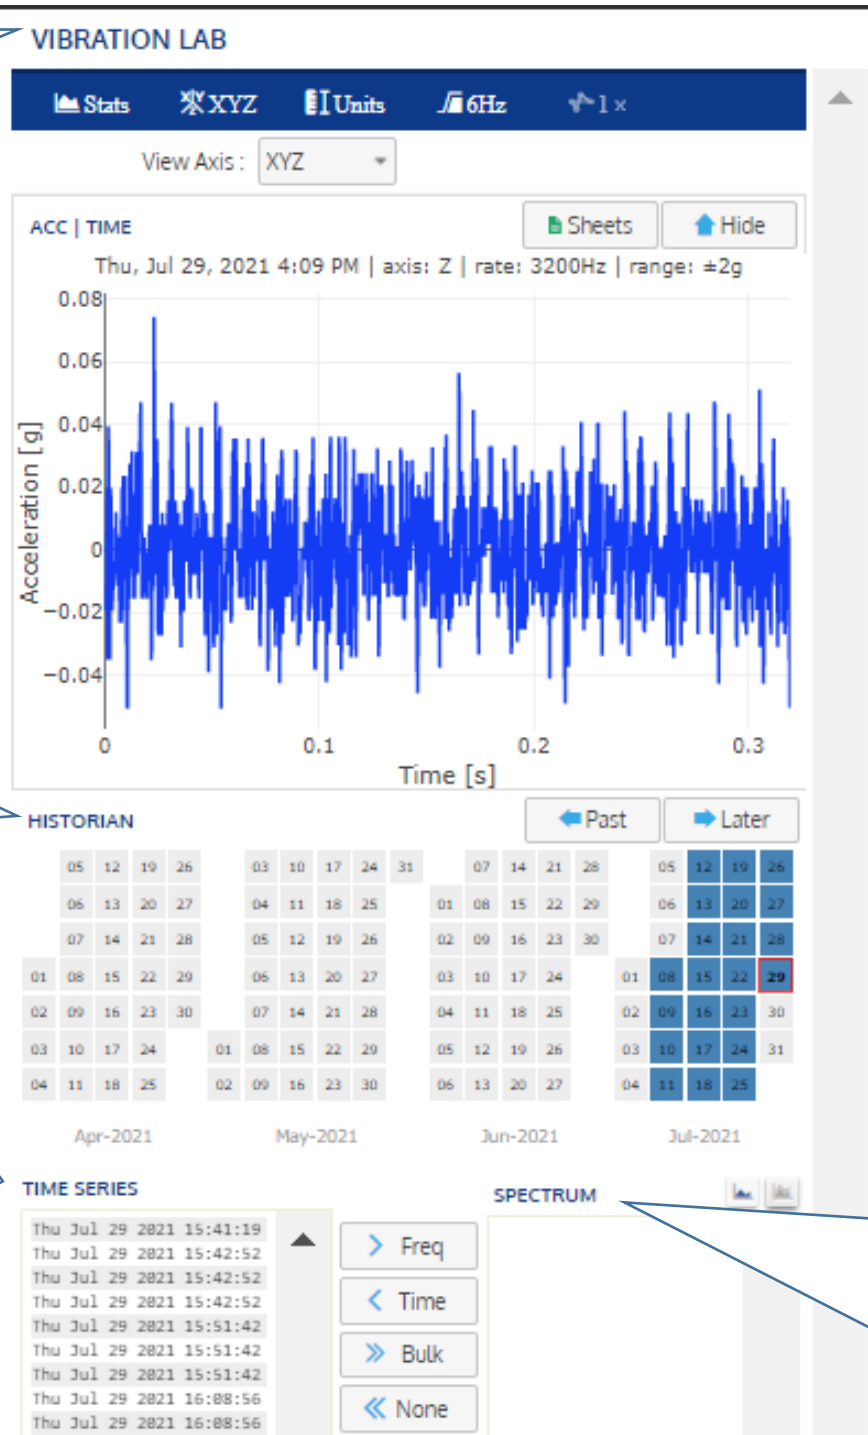


USER MANUAL

VIBRATION LAB

"XYZ" view axis filter tab

Select the measurement axis of which you want to see the measurements.

Selecting "XYZ" as the view axis will show all measurements of the selected day. Selecting "X" will only show the X axis measurements and similarly for selecting "Y" or "Z".

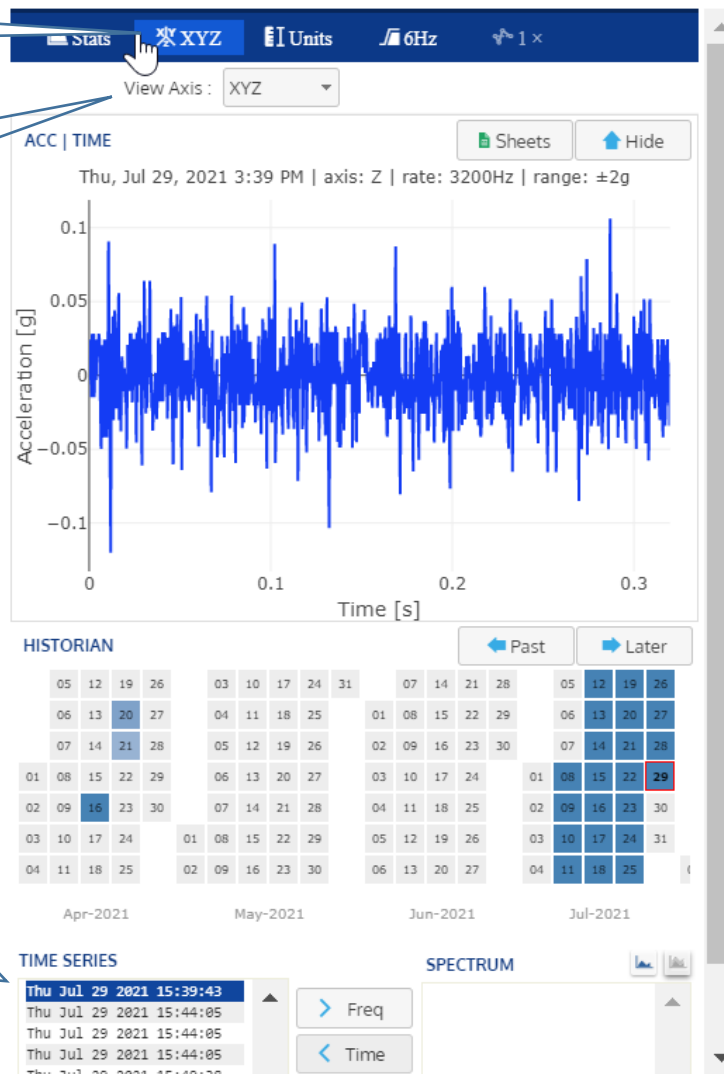

"Units" tab

Select graph units: g or mm/s.

VIBRATION LAB



Select predefined viewport settings to alter graph format.

USER MANUAL

"6Hz" High Pass Filter tab

Select the high pass cut off frequency to remove the DC component and the low frequency noise in the RMS signal. See section 3.6.4.3 for more information.

Highpass : 6Hz

1/f detrend :


Enable/disable 1/f flicker noise detrending (only for velocity spectra).

"1X" averaging tab

Enable/disable DFT averaging and select the number of averages. DFT averaging will decrease the noise level at the cost of a loss in resolution.

DFT Averaging : off

VIBRATION LAB

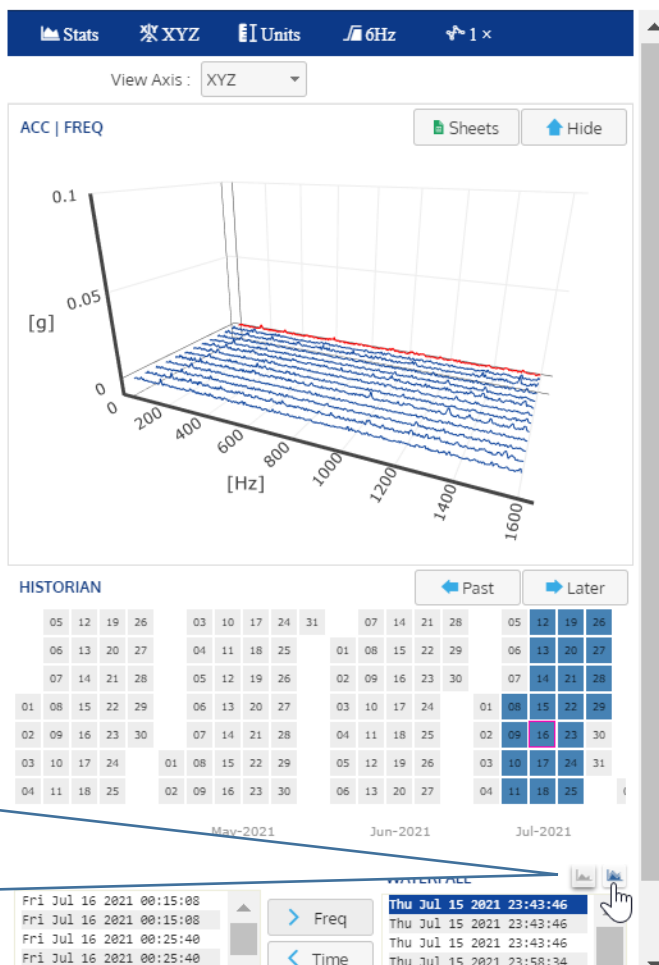


Clicking on the "Waterfall" icon changes the graph view from 2D to 3D. The graph now shows the combined spectra of all measurements from the spectrum box in a trending waterfall graph. Clicking on the "Spectrum" icon changes the view back to 2D mode.

USER MANUAL

3.6.4.1.1. Invalid data detection

The Sensor Dashboard will provide a warning in the Vibration Lab graph area instead of the plotted graph if the measurement you selected for plotting is not valid. The most likely cause of this invalid data is a low battery level.

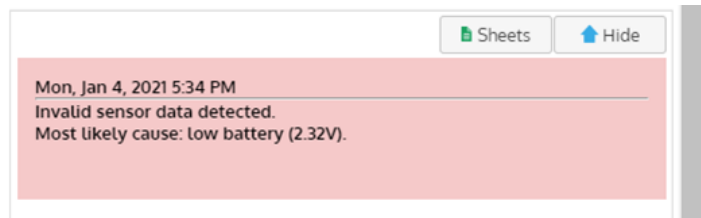**3.6.4.2. Statistics pane****VIBRATION LAB**

Open the Statistics pane.



USER MANUAL

STATISTICS shows the recorded RMS, Kurtosis and MAD values during a selected time interval.


"Units" tab

Select the desired units: g or mm/s (acceleration/velocity).

Select a start and end date in the proposed lists to create a graph. Click on a date in the historian to select a specific start or end date. Click on "Update" to update the graph. Click "Full" to select all available data. Click "Month" to select the data of the past month. Click "Week" to select the data of the past 7 days.

"6Hz" High Pass Filter tab


Select the high pass cut off frequency to remove the DC component and the low frequency noise in the RMS signal. See section 3.6.4.3 for more information.

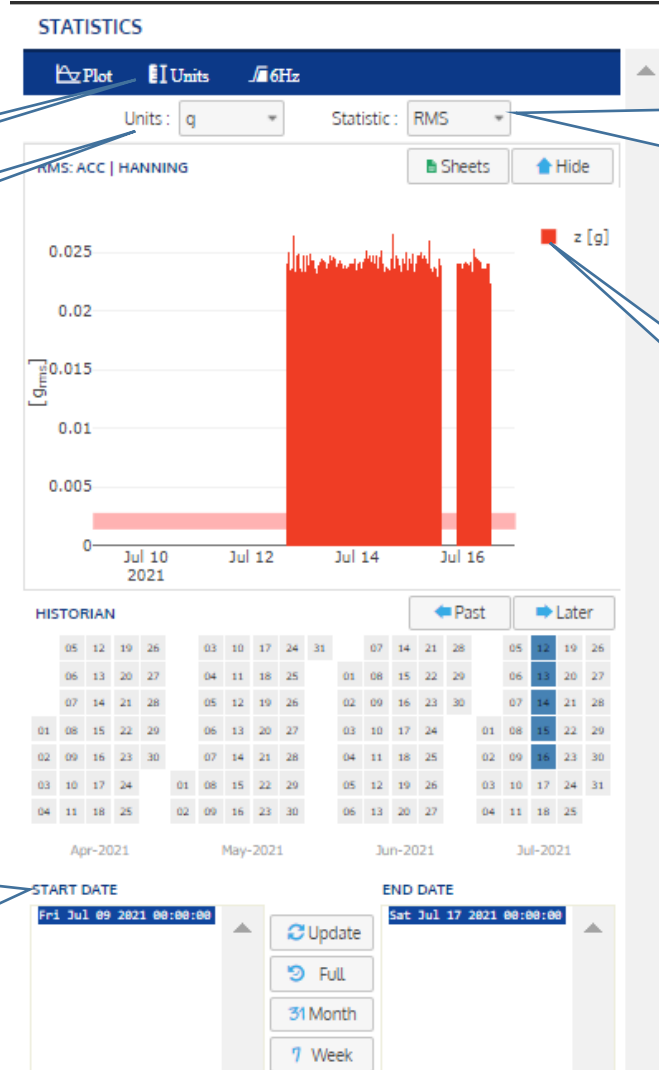

Select the RMS, Kurtosis or MAD statistic. Remark: the MAD statistic is only available for the MAD Vibration Sensor.

Select or unselect an axis by clicking on the colored square.

STATISTICS



USER MANUAL

3.6.4.3. Auto measurement and prefetch explained

Below is the explanation of the automatic vibration measurements and the correct use of 'prefetch' and RMS.

NOTE: RMS threshold does not apply for manually recorded vibrations with the REC button.

Automatic vibration measurements must be enabled, as shown above in section 3.5. The prefetch settings can be found and edited on 3 different places as shown in Figure 1 to Figure 3.

Note that the HPF value of 6Hz might not be the best setting. The choice of HPF value will be discussed below. Also, threshold=none is not recommended as explained below.

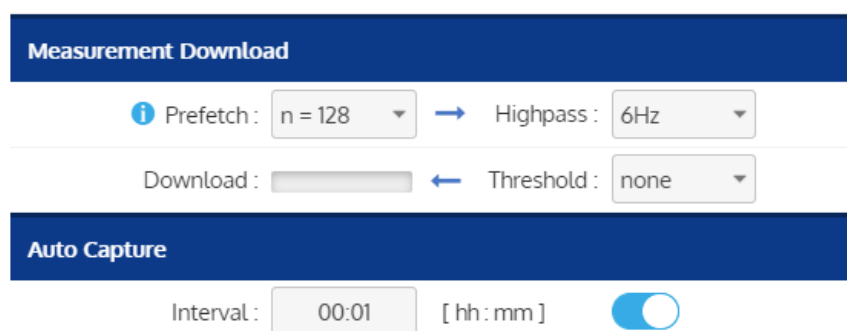


Figure 1: auto measurement setup and prefetch settings in vibration pane



Figure 2: prefetch settings in statistics lab pane



Figure 3: prefetch settings in vibration lab

These settings should be understood as follows:

1. The queue interval is 1 minute, so every minute a new measurement is started.
2. After a measurement is completed by the sensor, 128 'prefetch' samples (set in the vibration pane) are downloaded from the sensor.
3. The RMS value is calculated on these 128 samples (the "prefetch").
4. If the RMS value is larger than the threshold, the full vibration data is downloaded from the sensor. If not, all axes are suspended.
5. The threshold is 0g (none), so besides the 128 prefetch samples the full 1024 sample data is always downloaded in this case.

A very important parameter is the RMS high pass filter. This filter removes the DC offset (gravity) and the low frequency noise from the RMS signal (see Figure 4).

USER MANUAL

The RMS value is the power in all frequency bins above the HPF cut-off frequency. The images below (Figure 4 and Figure 5) are taken with no vibrations, just gravity and the sensor noise floor are seen.

However, with very few samples, such as in the case of a prefetch value of 128 samples, part of the DC offset and low frequency noise (plus the startup transient of the compression algorithm) may leak into higher frequency bins, due to the coarse resolution of the DFT. This can be seen below in Figure 5, for 128 prefetch samples. It can be seen here that an HPF value of 3 Hz is too low for a correct RMS value. In this case a better choice would be 6Hz or even higher.

Remark: The HPF cut-off frequency setting can be changed at any time to improve the interpretation and analysis of the DFT graphs (DFT graphs are always recalculated after each setting change). The HPF setting however has no influence on the data stored on the iQunet Server.

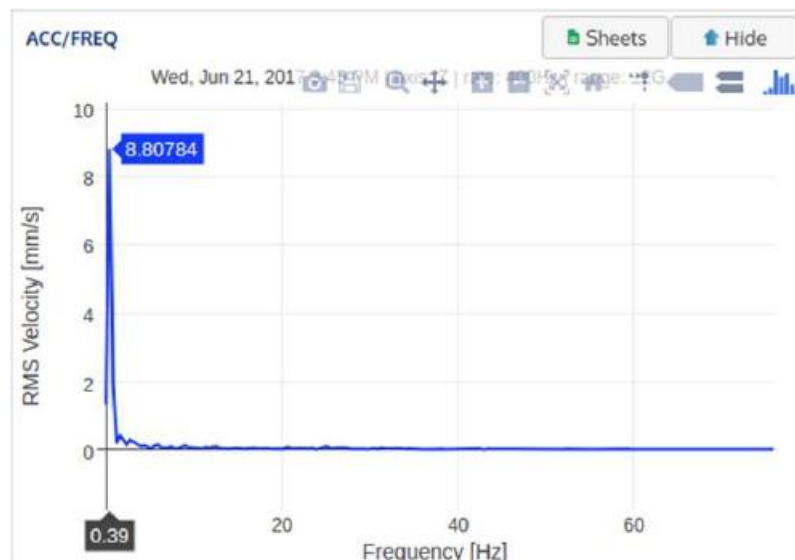


Figure 4: choosing the best setting for the high pass filter

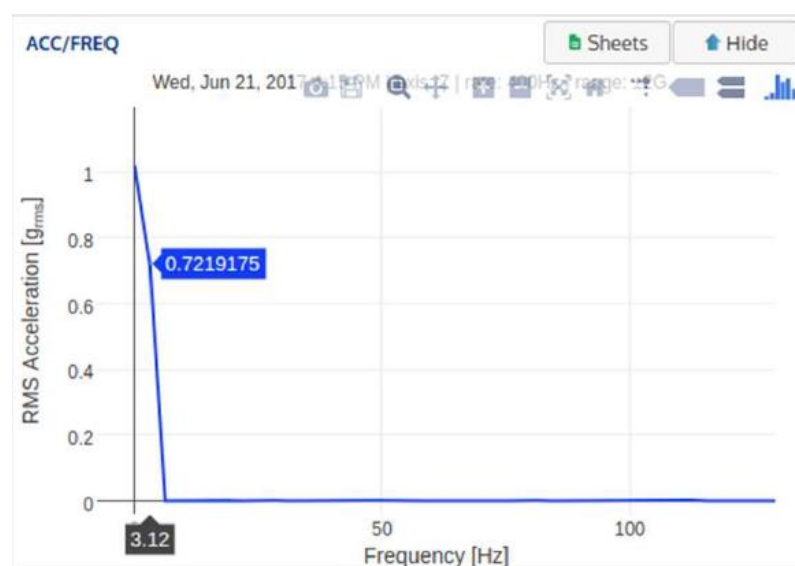


Figure 5: choosing the best setting for the high pass filter

USER MANUAL

iQunet recommends using the settings in the following table, based on the selected number of prefetch samples.

Table 1: recommended high pass filter settings

Number of prefetch samples	HPF value
256	6Hz or higher
128	12Hz or higher
64	25Hz or higher
32	50Hz or higher

Finally, to conserve battery power, it is important to set the threshold value to something higher than 0g (none) to prevent full downloads when the DUT is not active. It prevents the complete download of the 1024 samples in the example above. The result is that the battery lifetime may be extended at least one order of magnitude, since 10 times less data must be transmitted.

Clicking the information icon will show the flowchart of the Auto Capture procedure. The values in the flowchart change dynamically with the vibration/prefetch settings in the panes.

The screenshot shows the 'vibration pane' interface. It has two main sections: 'Measurement Download' and 'Auto Capture'. In the 'Measurement Download' section, there is an information icon (i) next to 'Prefetch: n = 128', followed by a right-pointing arrow and 'Highpass: 6Hz'. Below this, there is a 'Download:' label followed by a progress bar, a left-pointing arrow, and 'Threshold: none'. The 'Auto Capture' section below it has an 'Interval:' label followed by a time input field showing '00:01' and '[hh : mm]', and a toggle switch that is currently turned on.

Figure 6: vibration pane

USER MANUAL

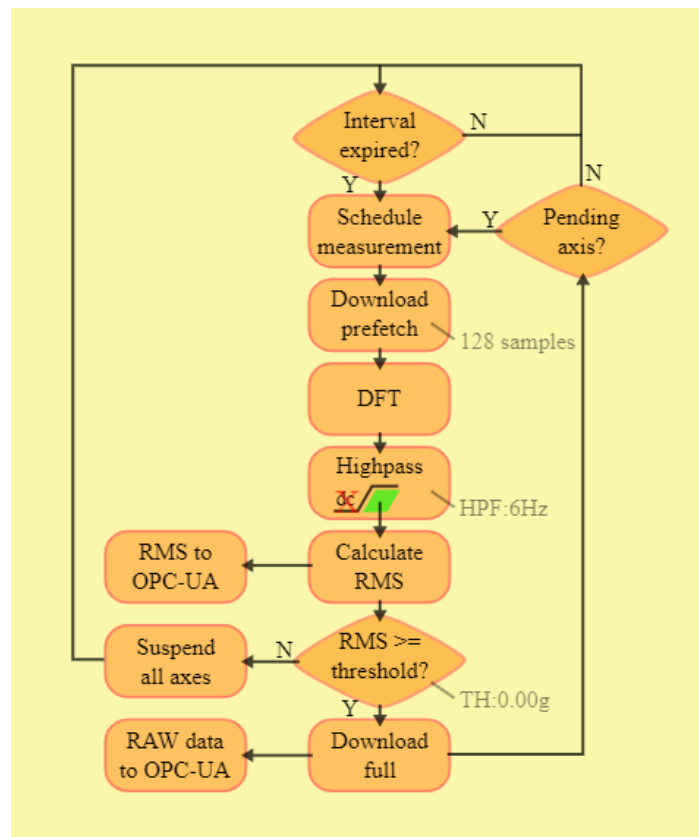


Figure 7: How data is sent to OPC UA and unwanted measurements are suspended (e.g. if the DUT is inactive)

3.6.5. IEPE Piezoelectric Accelerometer control

Pane appears when selecting an IEPE Piezoelectric Accelerometer device.

Select the ADC mode (voltage or current) depending on the used type of measurement device.

Select the sampling rate.

Select the number of samples.

By pressing "REC", the vibration measurement is triggered with the set parameters.

IEPE Interface

ADC Mode: IEPE

Power: 120mW

Measurement Setup

Rate: 4000Hz

Axis: Z

Samples: n = 1024

Sens: 100mV/g

Capture: REC

Level:

Select the maximum power level sent to the measurement device. The power is used to drive the built-in amplifier.

Select a measurement axis (X, Y or Z) in the dropdown menu.

Select the sensitivity level depending on the used type of measurement device.

Check if vibration level is high enough for download (see section 3.6.4.3).

USER MANUAL

Select a number of samples to make an antecedent RMS calculation for the vibration measurements. If the RMS value is below threshold, the full sensor download is aborted (see 3.6.4.3).

Progress of automatic download

Measurement Download

i Prefetch : → Highpass :

Download : ← Threshold :

A full measurement is downloaded when the RMS is above threshold. See section 3.6.4.3.

Select the high pass cut off frequency to remove the DC component and the low frequency noise in the RMS signal. See section 3.6.4.3 for more information.

The Vibration Lab, Statistics pane and prefetch RMS calculation function in the same way as described in sections 3.6.4.1 to 3.6.4.3 for the regular Vibration Sensor.

3.6.6. Current Clamp control

Pane appears when selecting a Current Clamp device.

Select the ADC mode (voltage or current) depending on the used type of measurement device.

Select the sampling rate.

Select the number of samples.

By pressing "REC", the current measurement is triggered with the set parameters.

IEPE Interface

ADC Mode : Power :

Measurement Setup

Rate : Axis :

Samples : Sens :

Capture : Level :

Select the maximum power level sent to the measurement device. The power is used to drive the built-in amplifier.

Select a measurement axis (X, Y or Z) in the dropdown menu.

Select the sensitivity level depending on the used type of measurement device.

Check if current level is high enough for download (see section 3.6.4.3).

USER MANUAL

Select a number of samples to make an antecedent RMS calculation for the current measurements. If the RMS value is below threshold, the full sensor download is aborted (see 3.6.4.3).

Progress of automatic download

Measurement Download

Prefetch : → Highpass :


Download : ← Threshold :

A full measurement is downloaded when the RMS is above threshold. See section 3.6.4.3.

Select the high pass cut off frequency to remove the DC component and the low frequency noise in the RMS signal. See section 3.6.4.3 for more information.

The Vibration Lab, Statistics pane and prefetch RMS calculation function in the same way as described in sections 3.6.4.1 to 3.6.4.3 for the regular Vibration Sensor. The only difference is that the Vibration Lab is renamed to Current Monitor and that the used units are current (A) and charge (A.s) instead of acceleration (g) and velocity (mm/s).

3.7. Content based graph settings

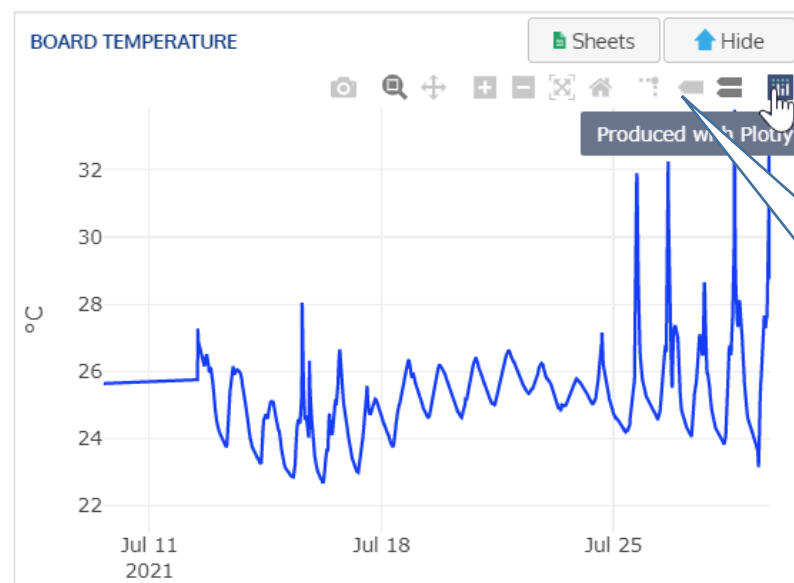

Graph buttons are content based and show up depending on the selected graph. Pointing to the icon will show the explanation of the button.

USER MANUAL

4. Export of data

4.1. Using OPC UA functionality

By connecting to the embedded OPC UA Server on the iQunet Server that is connected to the Base Station, you can read the data gathered by the iQunet sensors. Data is stored for a longer period, but the oldest data will be overwritten when the memory is full. It is strongly advised to install an OPC UA historian server to save the data permanently. Please contact your network administrator for more information on how to access the data. By connecting an OPC UA client to the running iQunet OPC UA Server, you can read the data as it is gathered by the sensors. The graphs in the iQunet Dashboard are using the same OPC UA data from the same source. Figure 8 and Figure 9 show the same temperature data on the iQunet Dashboard and in the OPC UA client.

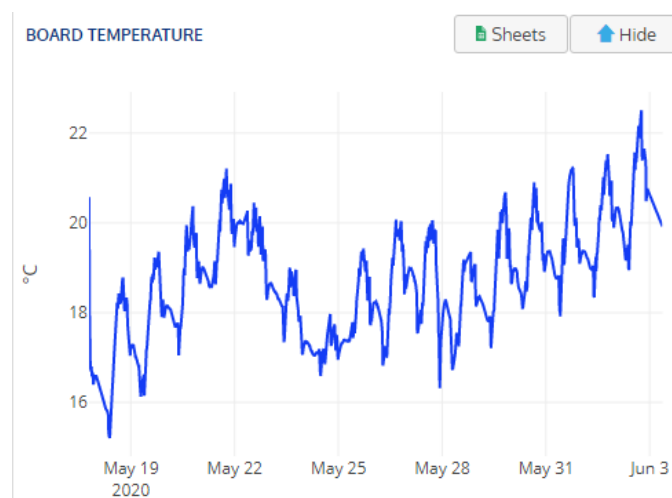


Figure 8: OPC UA data (board temperature) viewed in the iQunet Dashboard

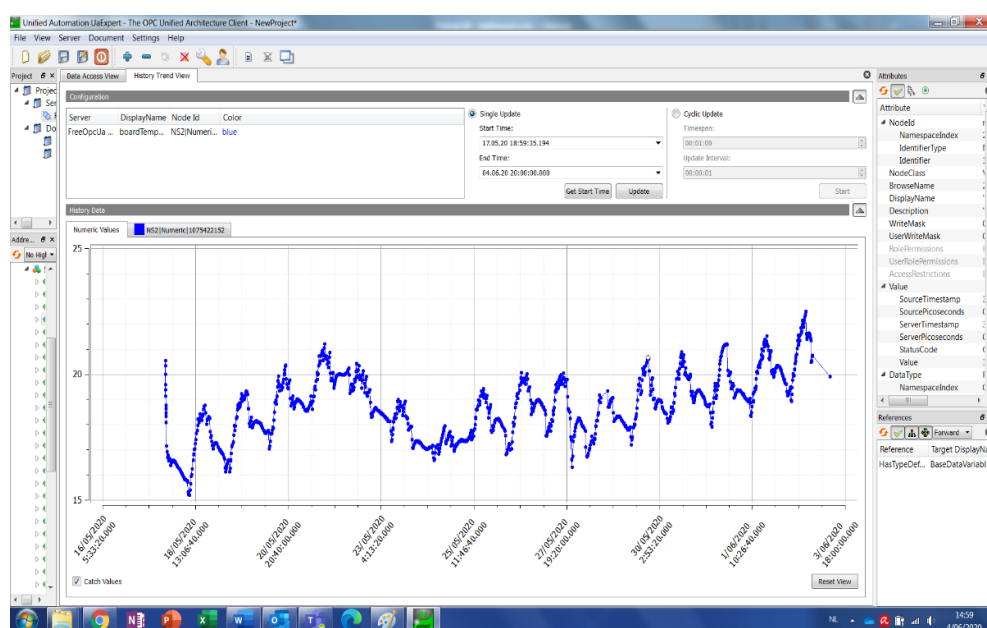



Figure 9: OPC UA data (board temperature) viewed in an OPC UA client

USER MANUAL


4.1.1. Setting up OPC UA client

For test purposes it is possible to set up an OPC UA client with free OPC UA client software.


1. Download the free OPC UA client software and install it from the following link: <https://www.unified-automation.com/products/development-tools/uaexpert.html>.
2. Open the UA Expert software and add a new server by selecting “Add” in the Server tab. Double click on “Double click to Add Server”.

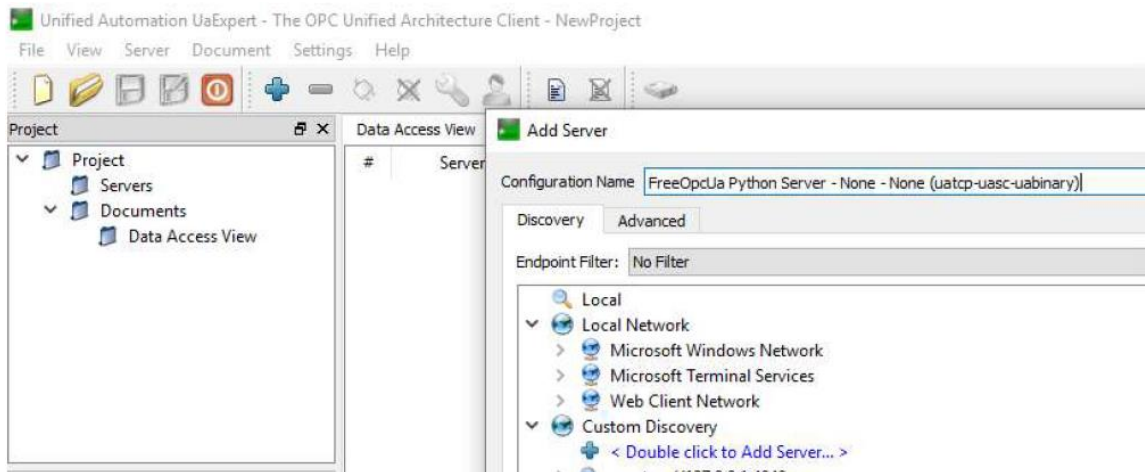

3. Edit the URL to e.g. `opc.tcp://25.28.10.80:4840` (see also section 5.2) and click OK.

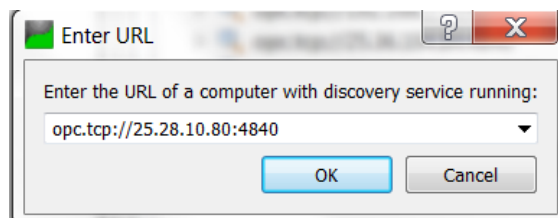


4. Select your added server in the list and click OK. If necessary, trust the certificate of the iQunet Server.

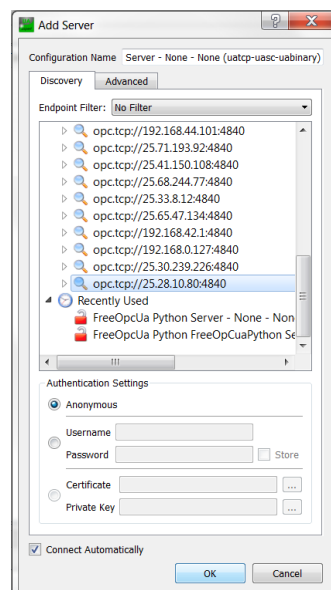


USER MANUAL

5. All connected iQunet sensors will appear in the object list.
6. Browse the attributes of the sensors by clicking on the tags.

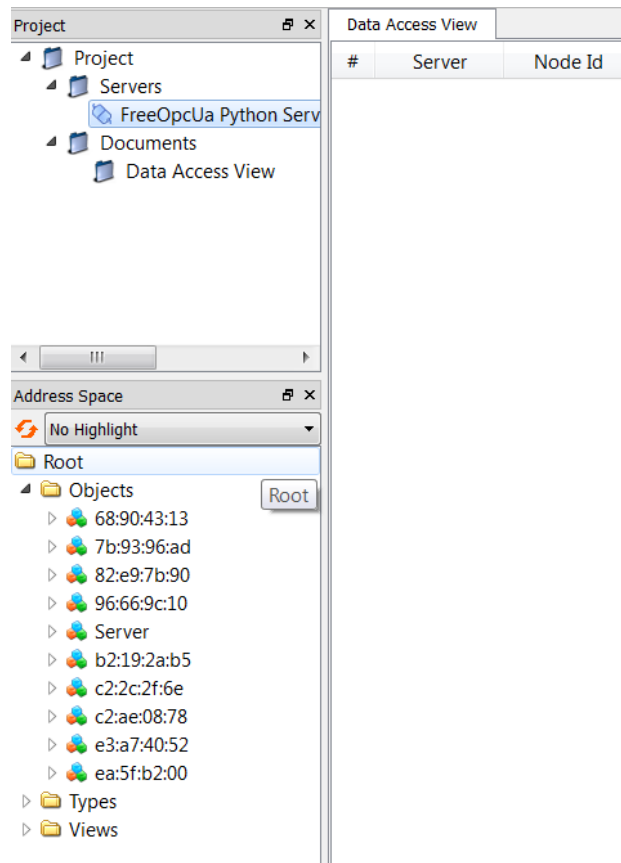


4.2. Using Google Sheets Export functionality

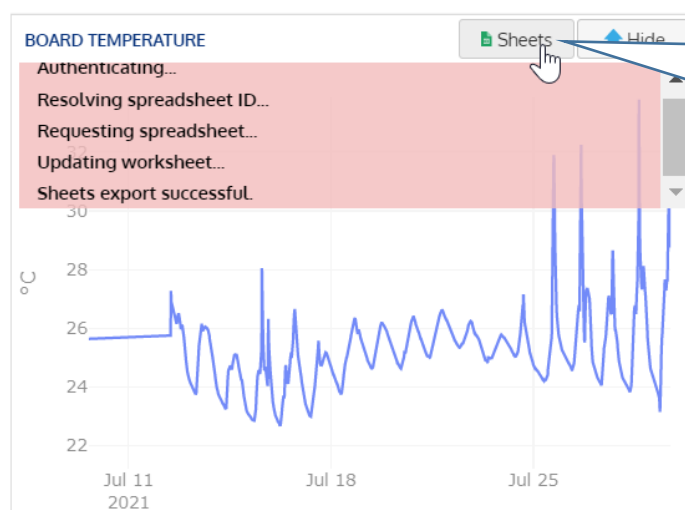

Pressing "Sheets" exports the OPC data to Google Sheets. By pressing the button again, the same sheet is updated with new values.

USER MANUAL

By clicking “Sheets”, a Google spreadsheet is created in the account you used to identify yourself at login.

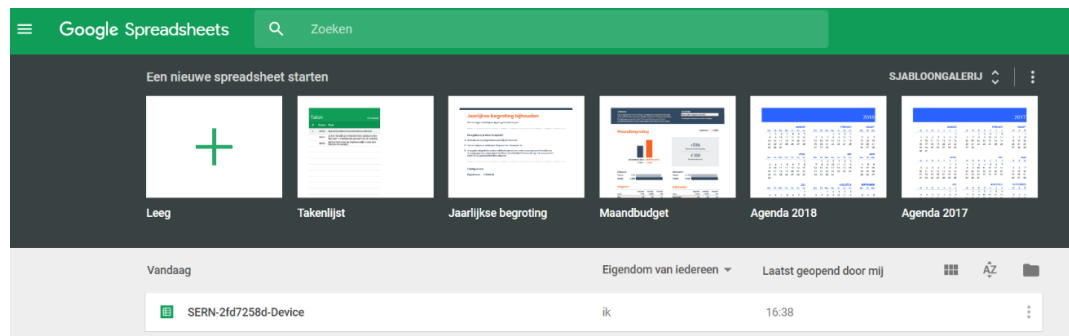

Go to Google Sheets, and you will see the file you created from this sensor by clicking the “Sheets” button. The data is updated every time you click the “Sheets” button in the same graph. Exporting new data parameters of the same sensor will create new tabs in the same file.


	A	B
1	ISO 8601 Date	boardTemperature
2		
3	2018-02-02 09:11	5.36
4	2018-02-02 09:21	5.36
5	2018-02-02 09:21	5.39
6	2018-02-02 09:41	5.52
7	2018-02-02 09:51	5.57
8	2018-02-02 09:51	5.6
9	2018-02-02 10:11	5.07
10	2018-02-02 10:21	5.25
11	2018-02-02 10:31	5.23
12	2018-02-02 10:31	5.23
13	2018-02-02 10:51	5.31
14	2018-02-02 11:01	4.44
15	2018-02-02 11:21	4.61
16	2018-02-02 11:21	4.61
17	2018-02-02 11:41	5.12

Open the file you created, and you can explore the data points or use plug-ins to analyze the data. Share the file with others by clicking the right upper blue button. Shared files will also be updated with new data once created. It is also possible to save the data in Microsoft Excel format.


USER MANUAL

4.3. Using Data Explorer Export functionality

Open the “Data Explorer” functionality by clicking on the “Export” symbol on the left-hand side in the Dashboard.

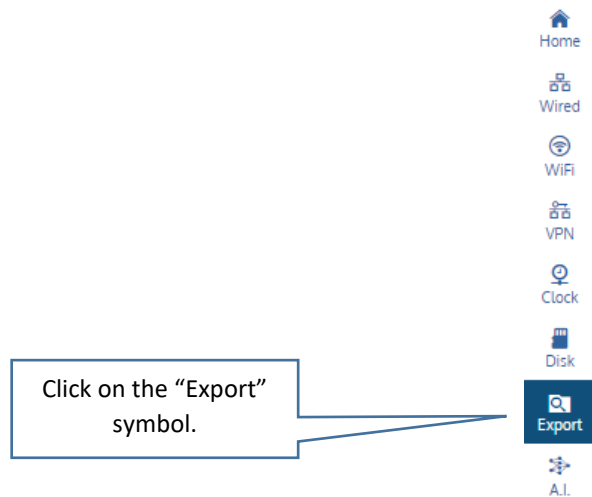

Select a device and according attribute on the left.

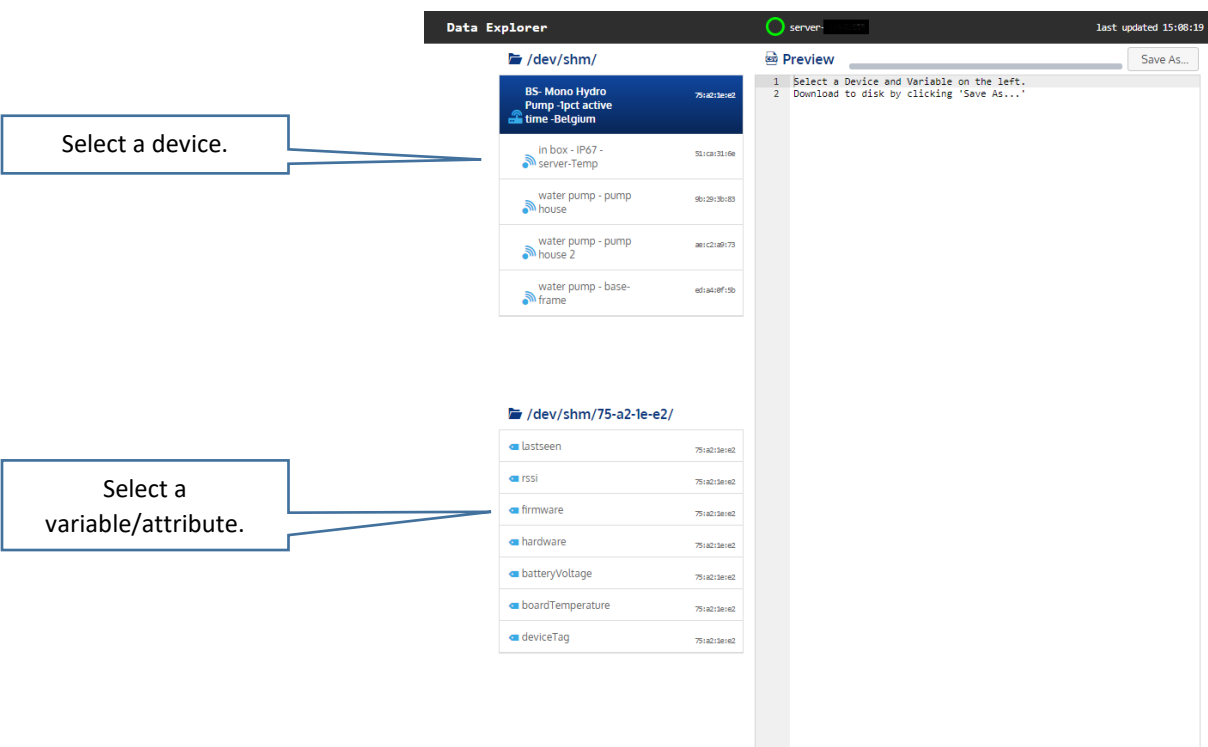

USER MANUAL

The data for this attribute will be loaded in the text box on the right in a csv format. Click on “Save As...” to download the data as a .csv file. For large amounts of data, the data loading might take a few minutes.

The screenshot shows the 'Data Explorer' interface. On the left, a tree view shows the directory structure: `/dev/shm/` and `/dev/shm/51-ca-31-6e/`. Under `/dev/shm/`, there are several attributes like 'BS- Mono Hydro', 'Pump -lpct active', 'time -Belgium', 'in box - IP67 - server-Temp', 'water pump - pump house', 'water pump - pump house 2', and 'water pump - base-frame'. Under `/dev/shm/51-ca-31-6e/`, there are attributes like 'lastseen', 'rssi', 'firmware', 'hardware', 'sampleRate', 'numSamples', 'formatRange', 'batteryVoltage', 'boardTemperature' (which is selected and highlighted in blue), and 'queueEnabled'. On the right, a preview of the '51-ca-31-6e_boardTemperature.csv' file is shown, displaying a table with two columns: a timestamp and a temperature value. The 'Save As...' button is circled in red.

Line	Timestamp	Temperature
1	2020-06-04T12:55:15.982000+00:00	29.052
2	2020-06-04T12:46:06.723000+00:00	29.384
3	2020-06-04T12:29:45.907000+00:00	29.352
4	2020-06-04T12:29:44.690000+00:00	29.352
5	2020-06-04T12:13:23.919000+00:00	29.405
6	2020-06-04T11:57:04.759000+00:00	29.298
7	2020-06-04T11:48:58.459000+00:00	29.234
8	2020-06-04T11:48:57.274000+00:00	29.245
9	2020-06-04T11:32:38.297000+00:00	28.783
10	2020-06-04T11:16:19.538000+00:00	28.794
11	2020-06-04T11:16:18.318000+00:00	28.816
12	2020-06-04T10:59:58.815000+00:00	28.794
13	2020-06-04T10:43:39.937000+00:00	28.805
14	2020-06-04T10:28:22.569000+00:00	28.880
15	2020-06-04T10:15:06.794000+00:00	28.794
16	2020-06-04T10:04:56.274000+00:00	28.751
17	2020-06-04T10:04:55.075000+00:00	28.762
18	2020-06-04T09:48:34.241000+00:00	28.569
19	2020-06-04T09:33:15.709000+00:00	28.644
20	2020-06-04T09:16:54.359000+00:00	28.665
21	2020-06-04T09:00:56.159000+00:00	28.751
22	2020-06-04T08:47:39.138000+00:00	28.858
23	2020-06-04T08:37:28.605000+00:00	28.901
24	2020-06-04T08:34:31.560000+00:00	28.794
25	2020-06-04T08:24:21.629000+00:00	28.858
26	2020-06-04T08:24:20.429000+00:00	28.869
27	2020-06-04T08:08:00.281000+00:00	28.923
28	2020-06-04T07:51:40.757000+00:00	28.848
29	2020-06-04T07:51:39.570000+00:00	28.848
30	2020-06-04T07:35:19.671000+00:00	28.858
31	2020-06-04T07:28:15.494000+00:00	28.869
32	2020-06-04T07:12:41.402000+00:00	28.891
33	2020-06-04T06:57:23.306000+00:00	28.987
34	2020-06-04T06:42:05.077000+00:00	29.105
35	2020-06-04T06:26:46.272000+00:00	29.127
36	2020-06-04T06:11:28.215000+00:00	29.084
37	2020-06-04T05:56:09.365000+00:00	29.169
38	2020-06-04T05:40:51.003000+00:00	29.245
39	2020-06-04T05:24:46.498000+00:00	29.277
40	2020-06-04T05:08:25.282000+00:00	29.287
41	2020-06-04T05:08:25.149000+00:00	29.255
42	2020-06-04T04:53:06.831000+00:00	29.309
43	2020-06-04T04:53:05.643000+00:00	29.309
44	2020-06-04T04:36:45.407000+00:00	29.320
45	2020-06-04T04:21:27.665000+00:00	29.384
46	2020-06-04T04:05:06.929000+00:00	29.427
47	2020-06-04T03:49:47.972000+00:00	29.491
48	2020-06-04T03:49:46.773000+00:00	29.448
49	2020-06-04T03:33:26.191000+00:00	29.566
50	2020-06-04T03:18:07.479000+00:00	29.491
51	2020-06-04T03:01:46.330000+00:00	29.588
52	2020-06-04T02:45:25.112000+00:00	29.652
53	2020-06-04T02:45:23.905000+00:00	29.641
54	2020-06-04T02:29:02.158000+00:00	29.641
55	2020-06-04T02:13:43.621000+00:00	29.663
56	2020-06-04T02:13:42.446000+00:00	29.684

4.4. Using APIs

4.4.1. General

GraphQL is a query language for APIs and a server-side runtime for executing queries by using a type system that is defined for the data. GraphQL is not tied to any specific database or storage engine and is instead backed by the existing code and data. GraphQL is typically served over HTTP via a single endpoint which expresses the full set of capabilities of this service. This contrasts with the REST APIs which expose a suite of URLs each of which exposes a single resource. Many different programming languages support GraphQL. A GraphQL spec was open sourced in 2015 and is now available in many environments and used by teams of all sizes. Some introductions can be found on <http://graphql.org/>.

Features:

- Syntax highlighting
- Intelligent type ahead of fields, arguments, types, and more
- Real-time error highlighting and reporting
- Automatic query completion
- Run and inspect query results

USER MANUAL

4.4.2. Starting with APIs

Before starting, we strongly recommend reading the “learn” section on the GraphQL website:

<http://graphql.org/learn/>.

All APIs can be reached via <http://xxx.xxx.xxx.xxx:8000/graphql> where “xxx.xxx.xxx.xxx” refers to the current iQunet Server IP address (see section 5.3). Please note that all documentation is included and can be found in the Documentation Explorer on the right-hand side.

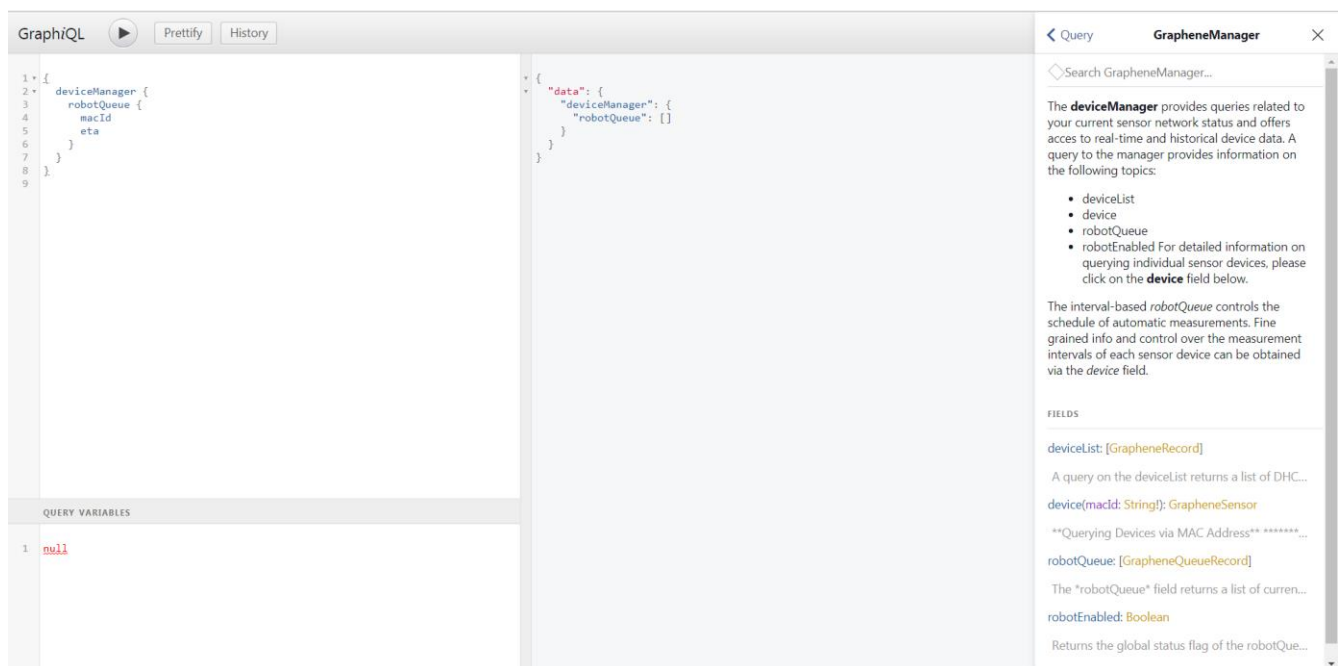


Figure 10: The iQunet graphical interactive in-browser GraphQL IDE (Integrated Development Environment)

Remark: it is also possible to use a client library to access the GraphQL Server. A list of all available GraphQL libraries can be found here: <https://graphql.github.io/code/>.


USER MANUAL

5. Connection to the iQunet Server

After connecting the iQunet Server to the 230V mains and if available to the network, there are several options to connect to the Server (see figure below):

1. Via WiFi hotspot (section 5.1). The IP address of the Server is always 192.168.42.1. An active network connection is optional.
2. Via local/direct access (LAN) where Server and client server are on the same subnet (section 5.2).
3. Via WiFi /WLAN (section 5.3). An active wireless network connection is required.
4. Via WebRTC (connect.iqunet.com). This only works for the Dashboard GUI. An active network connection is required. This procedure has already been described in section A.
5. Via Hamachi commercial VPN (section 5.4). An active Hamachi network is required.

Remark: section 5.5 describes which network connection (LAN, hotspot, or WiFi) takes precedence in connecting to the iQunet Server.

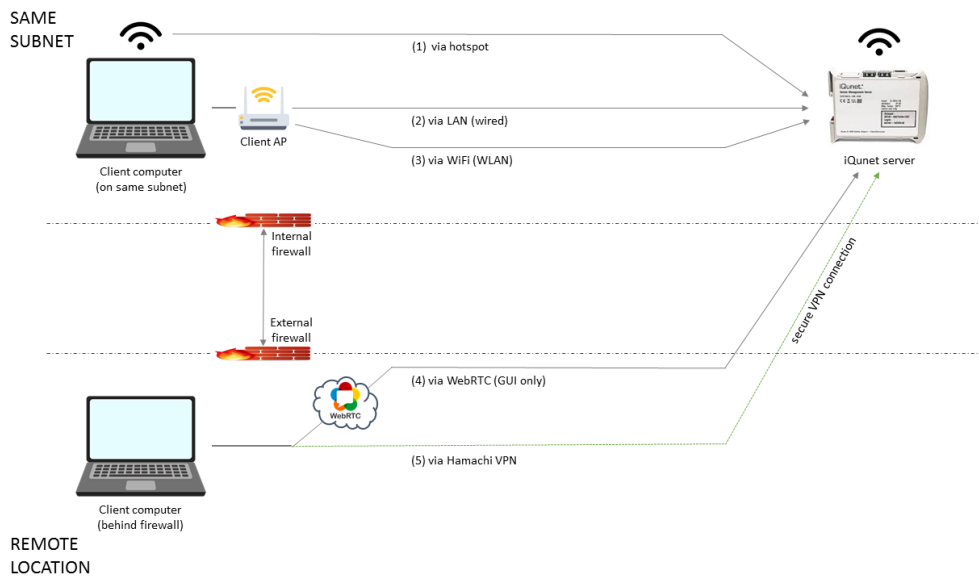

On all listening interfaces, the ports are fixed: 8000 for the Sensor Dashboard and GraphQL, 4840 for OPC UA, 9001 for the supervisor (pw: admin/admin) and port 22 for SSH.

USER MANUAL


5.1. Hotspot

5.1.1. Connect to hotspot

A WiFi hotspot is automatically created once the iQunet Server is connected to the 230V mains (even without connection to the network). A reboot of the server can be necessary if the hotspot does not become active immediately.

Remark: if the “Auto Off” option of the hotspot is enabled; the hotspot will only become active if there is no other active network connection available (wired or wireless). See section 5.1.2 for more info on the “Auto Off” mode.

To use the hotspot’s WiFi network on your PC, select the hotspot in your network center (SERN-xxxxxxxxxxx) and click Connect. The hotspot’s password is the Sensor Proxy ID (also used for the connection to WebRTC in section A). This ID is written on your iQunet Server (e.g. server-xxxxxxx).

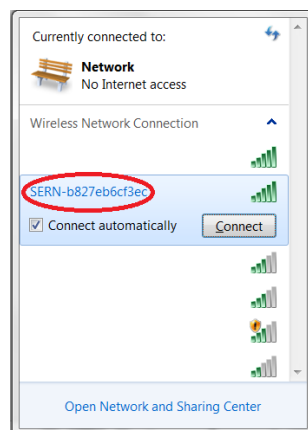


The IP address of the server is always 192.168.42.1. Once connected to the hotspot network, you can use this IP address to make a direct access connection to the server by browsing to <http://192.168.42.1:8000/dashboard/app> (see section 5.2 for more information). You can also use the server’s IP address to set up an OPC UA client or to access the GraphQL APIs (see sections 4.1.1 and 4.4.2).

When the iQunet Server is connected to the network, you can also connect via WebRTC as explained in section A.


5.1.2. Turn off hotspot

Connect to the iQunet Sensor Dashboard via WebRTC (see section A) or via direct access (<http://192.168.42.1:8000/dashboard/app>). Open the “Wireless – 802.11” panel to see the hotspot settings by clicking on the “WiFi” symbol at the left-hand side on the Dashboard.

USER MANUAL

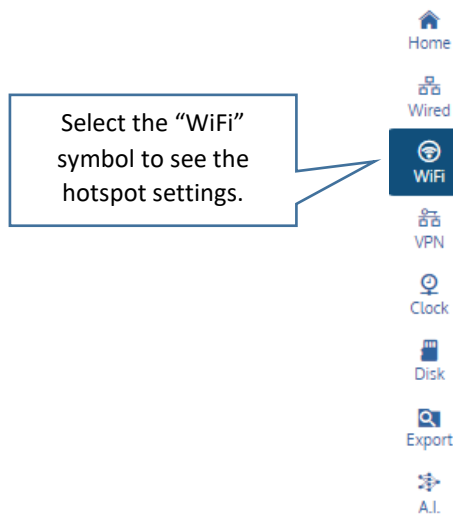

In the "WIFI HOTSPOT" section you can find the state of the hotspot (active/offline) and the hotspot's network name (SERN-xxxxxxxxxxx). Click on the hotspot's name (SERN-xxxxxxxxxxx) to see more details on the hotspot network.

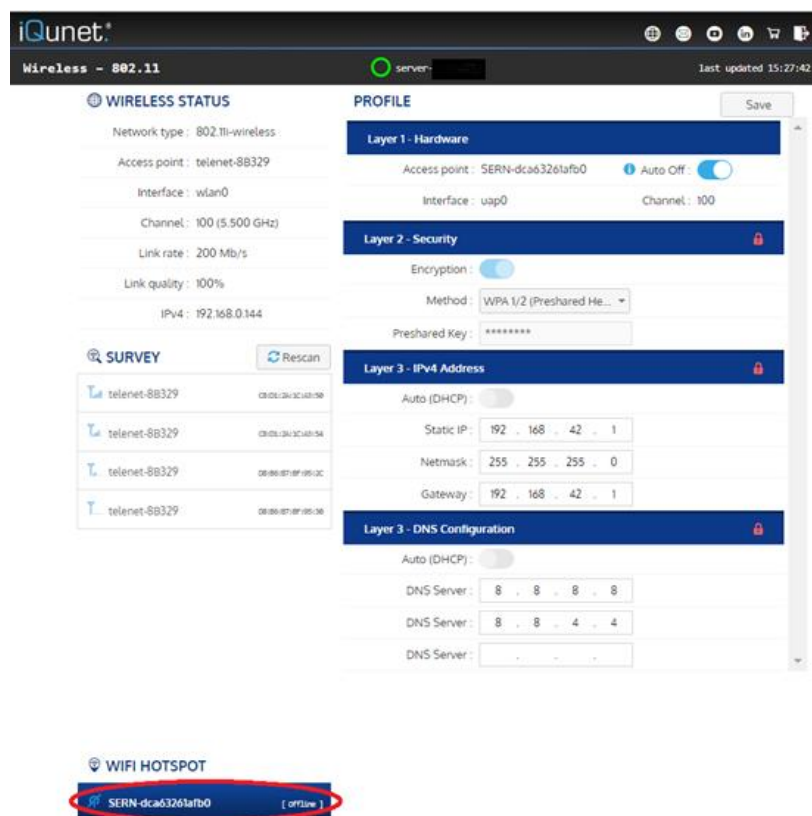


To turn off the hotspot, the user can activate the auto sleep mode of the hotspot by enabling "Auto Off" in the hardware layer. Slide the slider to the right and click the Save button in the upper right corner. When enabled, the hotspot will automatically turn off after maximum 10 minutes if another active wired or wireless

USER MANUAL

network connection is available. If the other network connection drops down, the hotspot will become active again.

Important remark: the hotspot will not turn off when there is still someone connected to it.

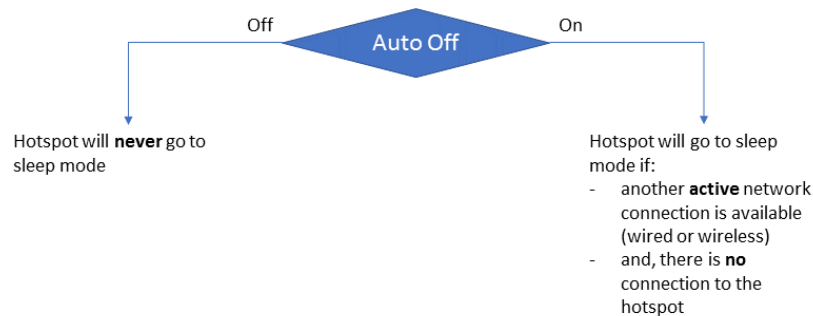

The other network settings shown below are not user adaptable.

PROFILE Save

Layer 1 - Hardware

Access point : SERN-dca63261afb0 Auto Off : ☒

Interface : uap0 Channel : 100

Layer 2 - Security 🔒

Encryption : ☒

Method : WPA 1/2 (Preshared He... ▼)

Preshared Key : *****

Layer 3 - IPv4 Address 🔒

Auto (DHCP) : ☐

Static IP : 192 . 168 . 42 . 1

Netmask : 255 . 255 . 255 . 0

Gateway : 192 . 168 . 42 . 1

Layer 3 - DNS Configuration 🔒

Auto (DHCP) : ☐


DNS Server : 8 . 8 . 8 . 8

DNS Server : 8 . 8 . 4 . 4


DNS Server : . . .

USER MANUAL

5.2. Direct Access setup (local access/intranet)

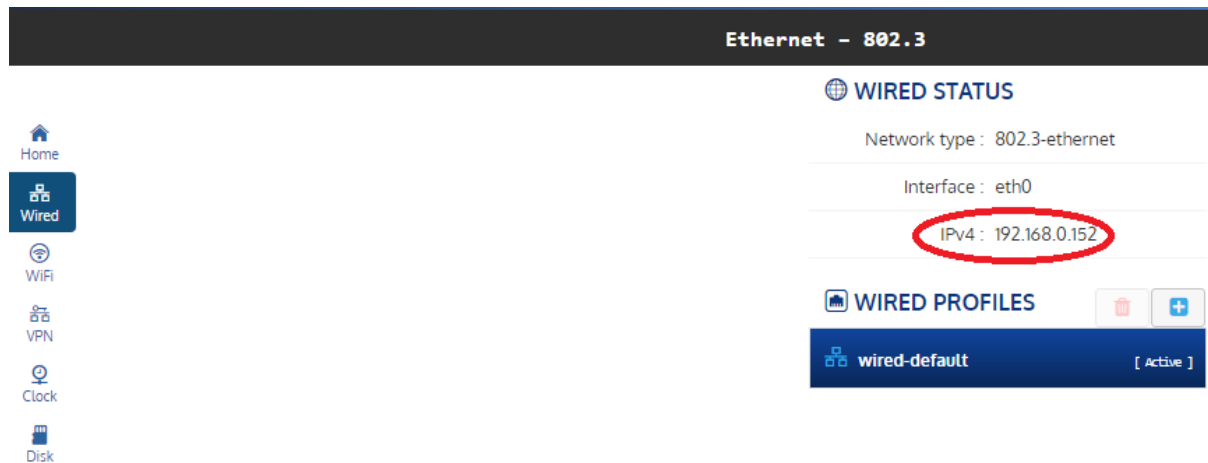

1. Open the “Ethernet – 802.3” panel by clicking on the “Wired” symbol on the left side.
2. Copy the network IPv4 address of the running iQunet Server.
3. Copy the address into <http://xxx.xxx.xxx.xxx:8000/dashboard/app> and open it in your Chrome browser.
4. From a computer in the SAME network and subnetwork you will now have direct access to the iQunet Server.
5. If the connection is established, “Direct Link” will appear next to the green circle instead of the server name “server-xxxxxxx”.

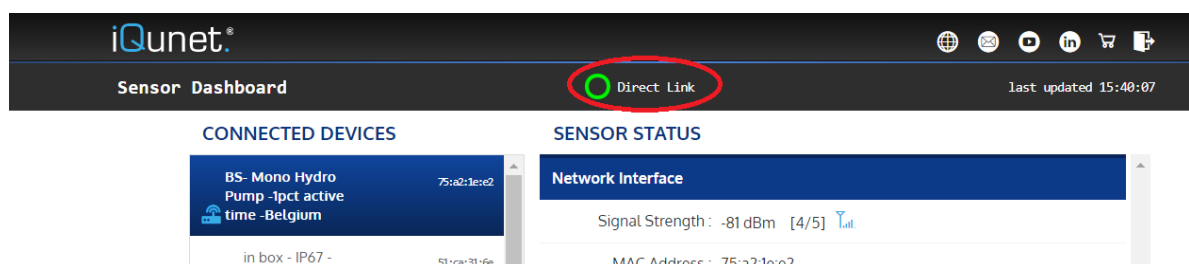


5.3. WIFI setup

Important remark 1: you can either use the hotspot functionality (a wired internet connection is not required) or a wired connection to the internet (either via a network in the neighborhood, or via a wired mobile MiFi connection) to establish the wireless connection. The wired connection can be disconnected once the Wi-Fi connection is established.


Important remark 2: if you are using multiple simultaneous connections, the Ethernet interface will have precedence over the Wi-Fi interface. The Ethernet interface is the preferred connection. The Wi-Fi interface can be used if Ethernet is not available.

USER MANUAL

Browse to the iQunet Sensor Dashboard via WebRTC (see section A) or via direct access to the hotspot (<http://192.168.42.1:8000/dashboard/app>). For more information on the connection to the hotspot see section 5.1.1. Open the “Wireless – 802.11” settings by clicking on the “WiFi” symbol on the left side.

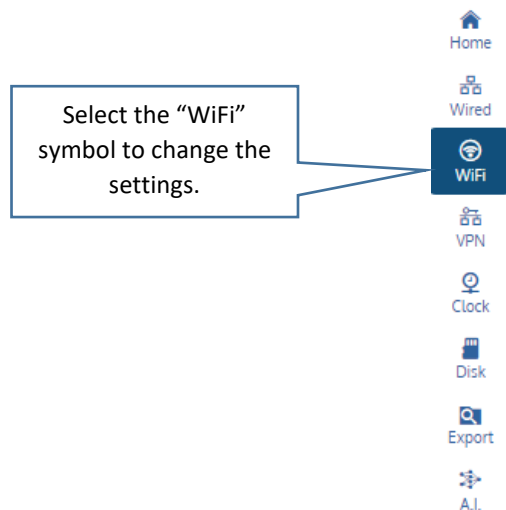

Rescan for wireless networks in the “SURVEY” section. Select the wireless network you want to connect with. Enable the encryption.

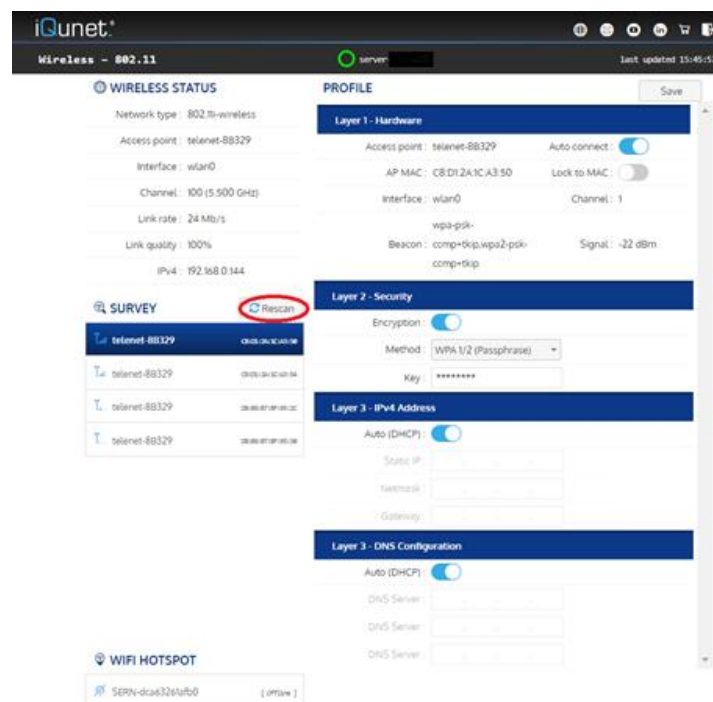

USER MANUAL

The screenshot shows the 'PROFILE' configuration page with three sections: Layer 1 - Hardware, Layer 2 - Security, and Layer 3 - IPv4 Address. Annotations include: a red circle around the 'Save' button; a callout box pointing to the 'Auto connect' toggle switch with the text 'Enable Auto connect.'; and another callout box pointing to the 'Encryption' toggle switch with the text 'Enable Encryption and select the used encryption method. Fill in the password key (and the identity) of the network.'

PROFILE Save

Layer 1 - Hardware

Access point : telenet-8B329 Auto connect : ☒

AP MAC : C8:D1:2A:1C:A3:50 Lock to MAC : ☐

Interface : wlan0 Channel : 1

wpa-psk-

Beacon : ccmp+tkip,wpa2-psk- Signal : -22 dBm

ccmp+tkip

Layer 2 - Security

Encryption : ☒

Method : WPA 1/2 (Passphrase)

Key : *****

Layer 3 - IPv4 Address

Auto (DHCP) : ☒

Static IP : . . .

Netmask : . . .

Gateway : . . .

Now press the “Save” button on top of the pane.

Enable the “Auto Off” option of the hotspot in the “Wireless – 802.11” control panel so the hotspot will be disabled immediately when a Wi-Fi connection is detected (see section 5.1.2 for more information on how to turn off the hotspot).


If you are using a wired connection, disconnect the Ethernet cable.

Put the iQunet Server with the connected Base Station on the desired spot in reach of the selected Wi-Fi network.

USER MANUAL

5.4. Hamachi VPN

In the “Hamachi – VPN” section you can join an existing VPN network. Open the “Hamachi - VPN” panel by clicking on the “VPN” symbol on the left side.

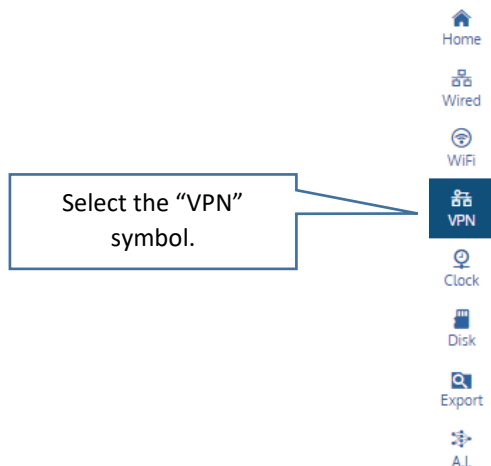

To create a Hamachi VPN network, browse to <https://secure.logmein.com/central/Central.aspx> and create an account or log in with your account credentials.

USER MANUAL

Go to the Networks section and click on “Create Networks” if this is the first network you create or “Add Network” for the following networks.

The screenshot shows the LogMeIn dashboard. On the left is a sidebar with navigation links: Buy Now, Computers, Users, Reports, Networks (circled in red), My Networks, Deployment, Network Settings, Refer a friend, and Application Discovery. The main content area is titled 'Get Started Now with On-Demand VPN Connectivity'. It contains three cards: 'Deploy Hamachi', 'Create Networks' (circled in red), and 'Add Clients'. The 'Create Networks' card has a sub-header 'Set up virtual networks: mesh, hub-and-spoke or gateway.'

The screenshot shows the 'Networks' section of the LogMeIn interface. On the left is a sidebar with navigation links: Buy Now, Computers, Users, Reports, Networks (circled in red), and My Networks. The main content area has a header 'Networks' and two buttons: 'Add Client' and 'Add Network' (circled in red). Below these buttons is a table with columns 'Client' and 'Client ID'. The table contains one entry: 'test_network' with a status of 'Hub-and-spoke • Free • 2 / 5 Clients • 2 online'.

Fill out the network name. Select “Hub-and-spoke” as the network type and click Continue.

Add Network (Step 1)

The screenshot shows the 'Add Network' form (Step 1). The 'Network type and name' section has a 'Network name' field with the value 'test_network' and a 'Network description (optional)' field. Below these fields are three network type options: 'Mesh', 'Hub-and-spoke' (selected), and 'Gateway'. Each option has a corresponding diagram. Below the network type options is a section titled 'Hub-and-spoke Network' with a description: 'This network type provides more strict control over network members in terms of who is connected to whom. Hubs (servers) are connected to everyone else, spokes (workstations) are connected only to hubs, but not to each other. It is a typical choice for simple corporate use cases, where a workstation needs connection to servers only.' At the bottom are 'Continue' and 'Cancel' buttons.

USER MANUAL

Check the “Must be approved” option in the “Join Requests” section and click Continue.

Add Network (Step 2)**Join Requests**

- ☐ Accept automatically
☒ **Must be approved**
☐ Members can be added on the web only

Network password

- ☐ A password is required to join this network

Network password

Confirm password

Clients requesting to join the network must enter the password. If you do not set a password, we recommend setting the Join Request behavior to **Must be approved** or **Members can be added on the web only**.

Subscription

- ☒ Free (up to 5 members) - Never expires ▼
☐ Buy Standard (up to 32 members per network) - €44.00/year
☐ Buy Premium (up to 256 members per network) - €179.00/year
☐ Buy Multi-network (up to 256 members, any number of networks) - €269.00/year

[Continue](#)[Cancel](#)

Click Continue.

Add Network (Step 3)

Network: test_network



Choose the computers that will act as hubs in this network.

[Read more](#)

Hubs are typically the file servers or mail servers in your physical network. Select hubs from the list of clients attached to your account. Hubs can be added or removed at any time.

Select the hubs

No eligible members to list.

[Continue to Add Client](#)[Continue](#)[Skip this](#)[Cancel](#)

USER MANUAL

Click Finish.

Add Network (Step 4)

Network: test_network

 **Select clients to join this network as spokes.**
Clients from other accounts can also request to join this network from the client interface.
[Read more](#)

Select the spokes

No eligible members to list.

 [Continue to Add Client](#)

[Finish](#) [Cancel](#)

Your VPN network is now created. You can find the ID by editing the network.

Edit Network

test_network ▼

[Members](#) [Join Requests](#) [Settings](#) [Password](#) [Subscription](#) [Delete](#)

Settings saved.

ID	Name	Type	Description
393-966-144	test_network	Hub-and-spoke	

Use the ID when joining this network from the Hamachi client.

No members to show or add to this network.

[Save](#) [Cancel](#)

Add the VPN network in the iQunet Sensor Dashboard by clicking the plus sign in the “Hamachi – VPN” panel.

iQunet.®

Hamachi – VPN server: [redacted]

VPN STATUS

Network type : P2P, VPN

Interface : ham0

Service : ☒

Status : logged in


IPv4 : 25.146.87.127

PEER NETWORKS 

No networks found.


USER MANUAL

Enter the network ID and click the Join button.

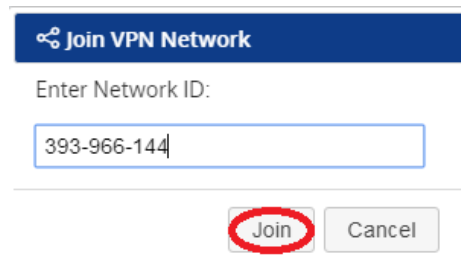

A dialog box titled "Join VPN Network" with a blue header. Below the header, it says "Enter Network ID:". There is a text input field containing "393-966-144". At the bottom right, there are two buttons: "Join" (highlighted with a red circle) and "Cancel".


Go back to the Hamachi Logmein website and accept the iQunet Server as a client in the “Join Requests” section of the created network.

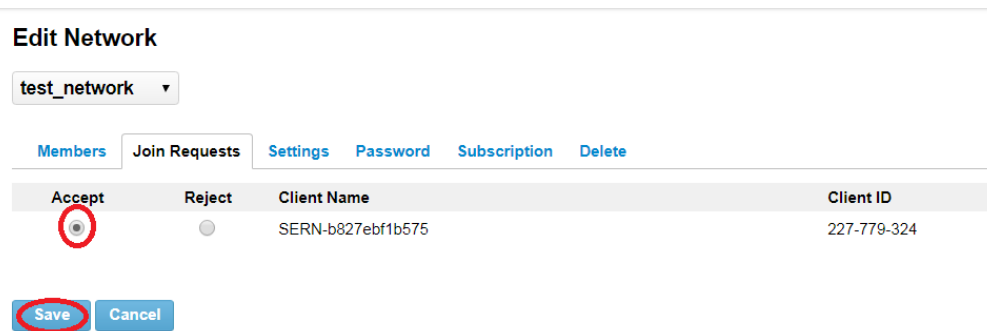

The "Edit Network" interface for "test_network". The "Join Requests" tab is active. It shows a table with columns: "Accept", "Reject", "Client Name", and "Client ID". There is one request from "SERN-b827ebf1b575" with Client ID "227-779-324". The "Accept" radio button is selected (highlighted with a red circle). Below the table are "Save" (highlighted with a red circle) and "Cancel" buttons.

Accept	Reject	Client Name	Client ID
☒	☐	SERN-b827ebf1b575	227-779-324

The iQunet Server will now appear in the Members section of the VPN network.

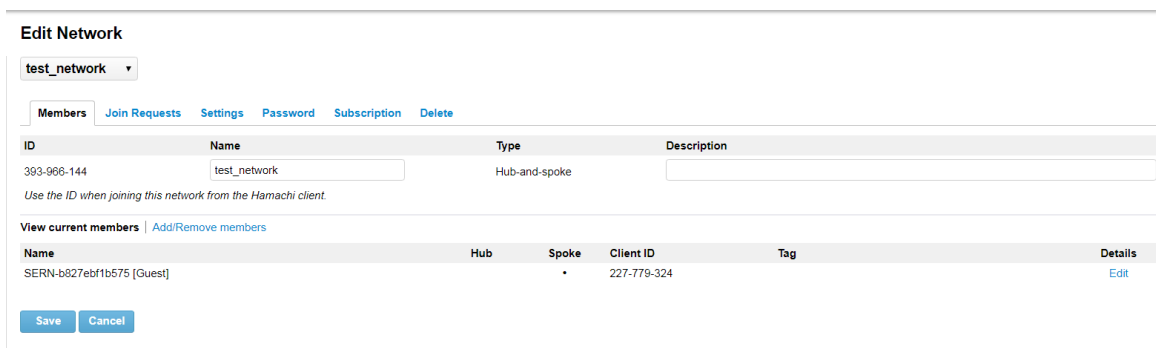

The "Edit Network" interface for "test_network". The "Members" tab is active. It shows network details: ID "393-966-144", Name "test_network", Type "Hub-and-spoke", and Description. Below this, it says "Use the ID when joining this network from the Hamachi client." There is a section "View current members" with a link "Add/Remove members". A table shows the current member: SERN-b827ebf1b575 [Guest] with Client ID "227-779-324". At the bottom are "Save" and "Cancel" buttons.

ID	Name	Type	Description
393-966-144	test_network	Hub-and-spoke	


Use the ID when joining this network from the Hamachi client.

Name	Hub	Spoke	Client ID	Tag	Details
SERN-b827ebf1b575 [Guest]		•	227-779-324		Edit


USER MANUAL

Reselect the “VPN” symbol on the left side in the iQunet Sensor Dashboard and the VPN network will appear in the list of peer networks.

Remark: the list of peer networks is not updated automatically since Hamachi doesn’t provide any sign or warning when changes have been applied. For this reason, you need to reopen the “Hamachi -VPN” panel to update the list of peer networks.

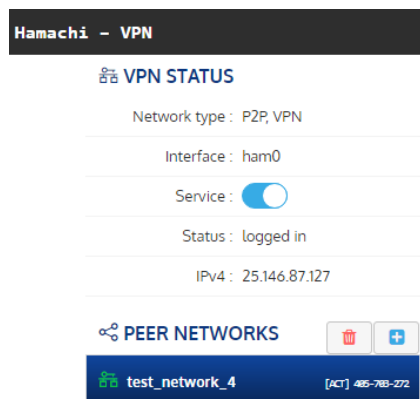

Set the SERN-xxxxxxxxxxx to act as a hub on the Logmein web page by clicking on “Add/Remove members”. Check the Hub box and press Save.

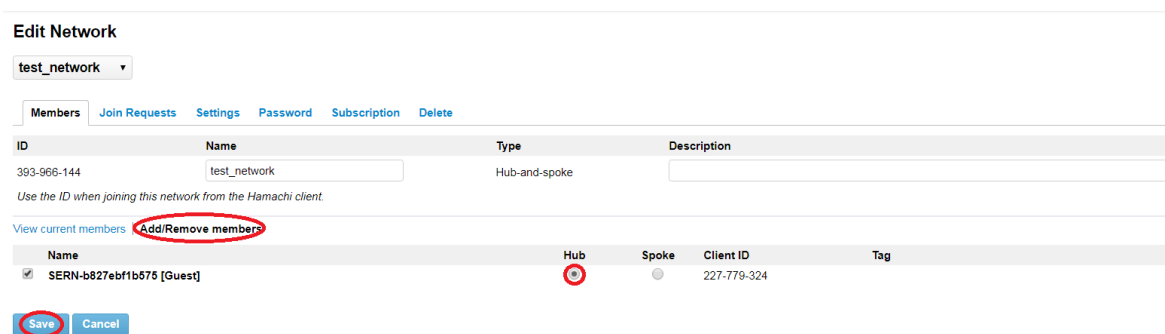


You now need to add your personal computer to this network. Download the Logmein Hamachi software from www.vpn.net.




USER MANUAL


Open the software and click on the Network tab. Select “Join an existing network”.

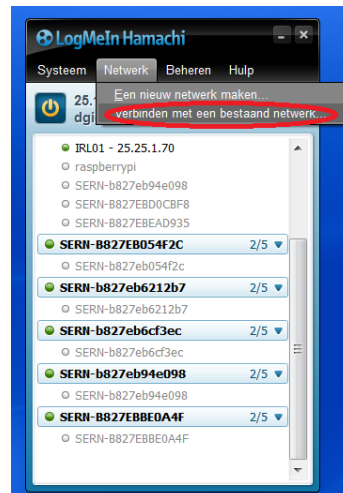

Fill out the network ID and click Connect. Confirm that you want to ask for membership.

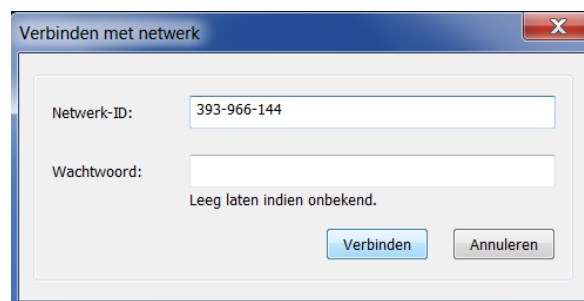

Accept your PC as a client in the Join Requests section on the Logmein page and click Save.

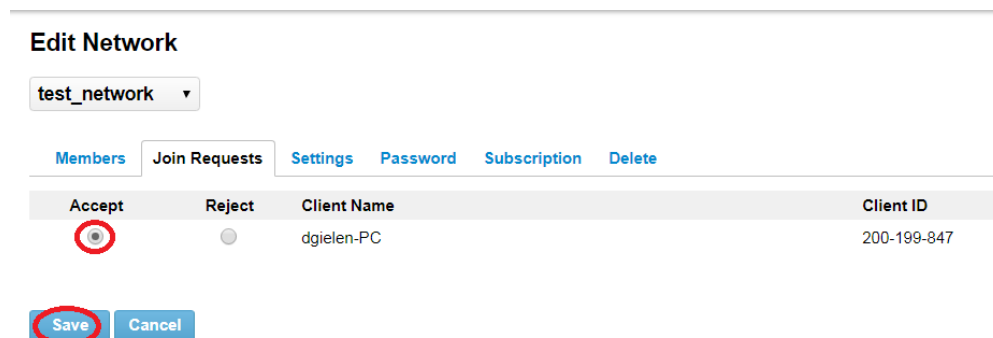

USER MANUAL

Now both your PC and the iQunet Server should be in the list of network members. Make sure that the iQunet Server is listed as a hub.

Edit Network

test_network ▾

Members
Join Requests
Settings
Password
Subscription
Delete

ID	Name	Type	Description
393-966-144	test_network	Hub-and-spoke	


Use the ID when joining this network from the Hamachi client.

View current members | Add/Remove members


Name	Hub	Spoke	Client ID	Tag	Details
dgielen-PC [Guest]		•	200-199-847		Edit
SERN-b827ebf1b575 [Guest]	•		227-779-324		Edit

Save
Cancel

You can find the IP address of this VPN network in the “Hamachi – VPN” control panel. You can now use this IP address instead of the IP address listed at “Ethernet – 802.3” to for example make a direct access connection or connect with UA Expert.

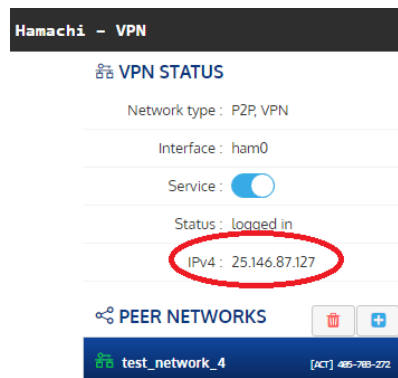

Copy the IP address into <http://xxx.xxx.xxx.xxx:8000/dashboard/app> and open it in your browser. You will now get a direct link to the iQunet Server.

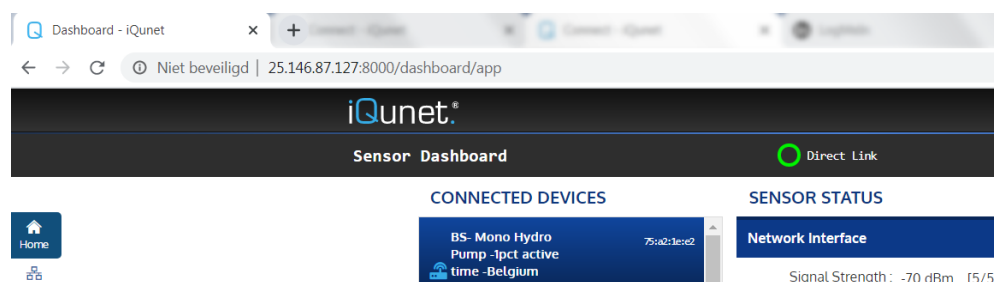


USER MANUAL

5.5. Preferred connections of the iQunet Server


The flowchart below shows which connection to the iQunet Server will take precedence if several connection types are used simultaneously.

- a) If there is a cabled LAN connection available, the cabled LAN connection will take precedence. The Wi-Fi connection and the Wi-Fi hotspot connection will not become active.
Remark: the Wi-Fi connection can however co-exist next to the cabled LAN connection. The Wi-Fi connection will not become active, but you can scan for wireless networks in the Sensor Dashboard, fill out the Wi-Fi connection details and turn on the “Auto connect” slider while connected via LAN (see section 5.3 for more information on how to activate a Wi-Fi connection). In the “Wireless – 802.11” pane you can see that the Wi-Fi connection has an IPv4 address, but this IP address cannot be used since the Server is working via the preferred LAN connection.
- b) If there is no LAN connection available (cable is unplugged), the Wi-Fi connection is the preferred connection. For the Wi-Fi connection to become active, an active Wi-Fi connection must be available and the “Auto connect” slider in the “Wireless – 802.11” pane needs to be set up to connect to one of the scanned Wi-Fi networks (see section 5.3 for more information on how to activate a Wi-Fi connection). The hotspot connection will not become active.
Remark: the LAN connection will show “unplugged” in the Sensor Dashboard in the “Ethernet - 802.3” pane instead of the IPv4 address.

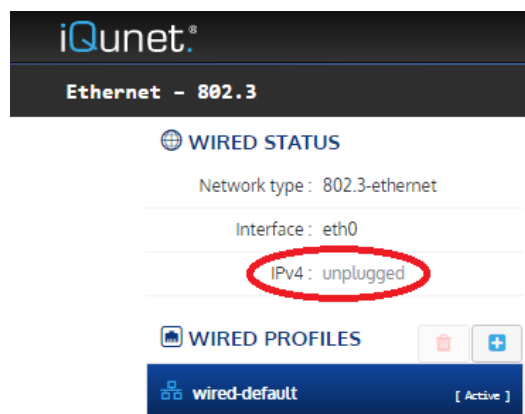

- c) If there is no LAN or Wi-Fi connection available and/or the Wi-Fi auto connect slider is turned off, the hotspot will wait for **60 seconds** for still another connection to pop up. If no other connection becomes active, the hotspot (SERN-xxxxxxxxx) will become active and will appear in your list of available Wi-Fi connections on your PC/phone. You can connect to the hotspot as described in section 5.1.
Remark: we strongly advice to turn the hotspot’s “Auto Off” slider on (blue). When there is a LAN or Wi-Fi connection available, the hotspot will turn off and the Server will switch back to a LAN or Wi-Fi connection.

USER MANUAL

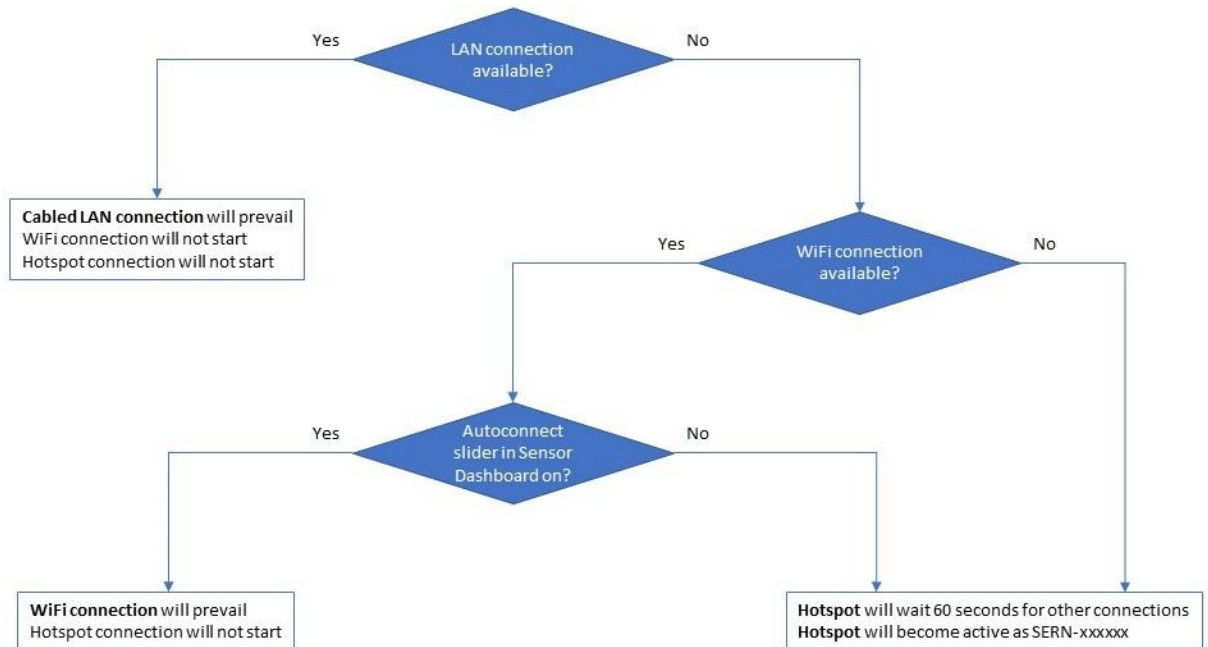



USER MANUAL

6. System clock

In the “System Clock” section you can set up your own Network Time Protocol (NTP) server to synchronize the hardware clock with. Normally the default NTP server is used (0.debian.pool.ntp.org). The iQunet system considers the drift and offset between the Real Time Clock (RTC) and the NTP clock so in most cases this default NTP server will work fine.

If you need to use your own NTP server for example when the default NTP server is blocked by the firewall, you can change the Primary NTP server.


Open the “System Clock” panel by clicking on the “Clock” symbol on the left-hand side in the iQunet Sensor Dashboard. Edit the Primary NTP (to for example time.google.com) and press “Save”.

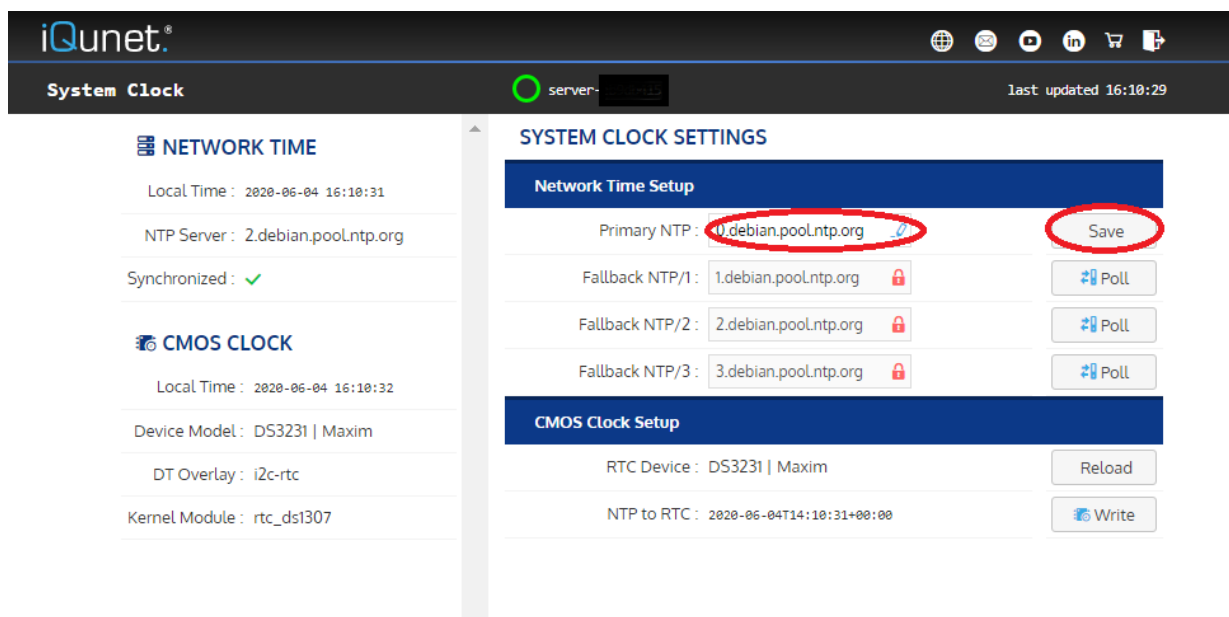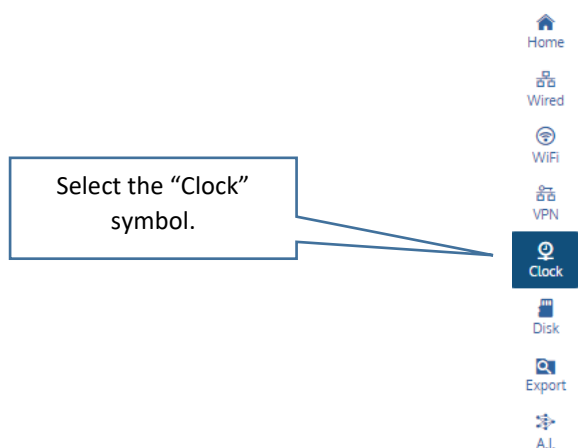


USER MANUAL

7. Anomaly Monitor

Open the “Anomaly Monitor” panel by clicking on the “A.I.” symbol on the left-hand side in the iQunet Sensor Dashboard.

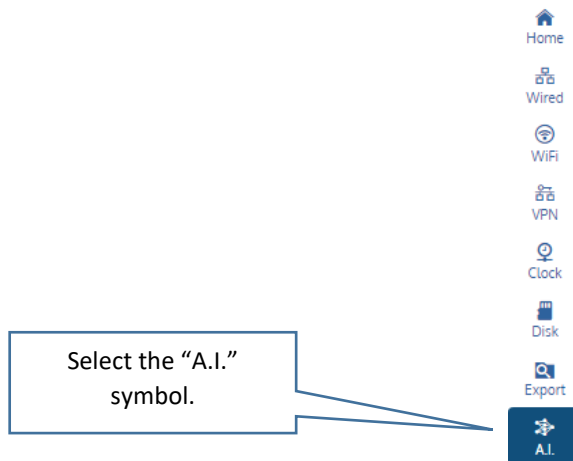


When you subscribe for the iQunet Anomaly Monitoring Service, a model will be created based on your acquired data set. All historical sensor data stored on your local iQunet Server will be automatically compressed and transferred once to the iQunet Machine Learning Servers (located in the iQunet premises) to calculate a machine learning data model. This model is then returned and saved on to your local iQunet Server for continuous local anomaly monitoring. New measurements that differ too much from the calculated data model are detected as anomalies and can be followed up and flagged (difference based on the Mean Squared Error).

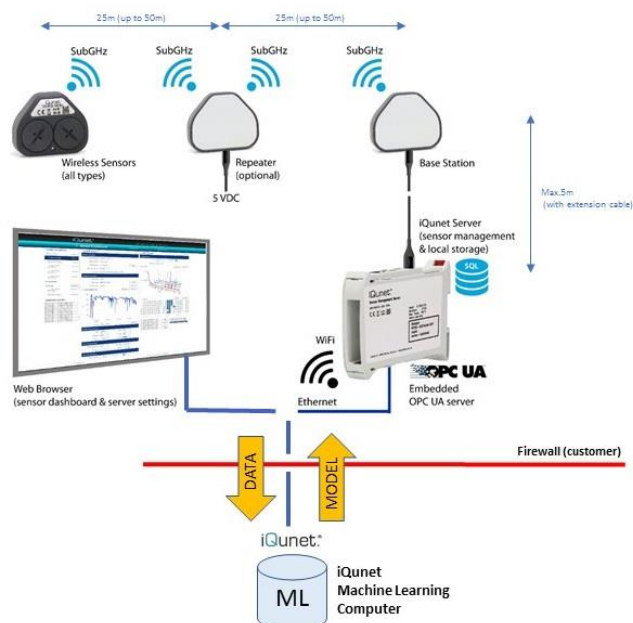

USER MANUAL

To start monitoring anomalies, select an existing sensor model in the “Model Summary” section. The model name is composed of the sensor settings (for example TFL3_8192_200_2_X).

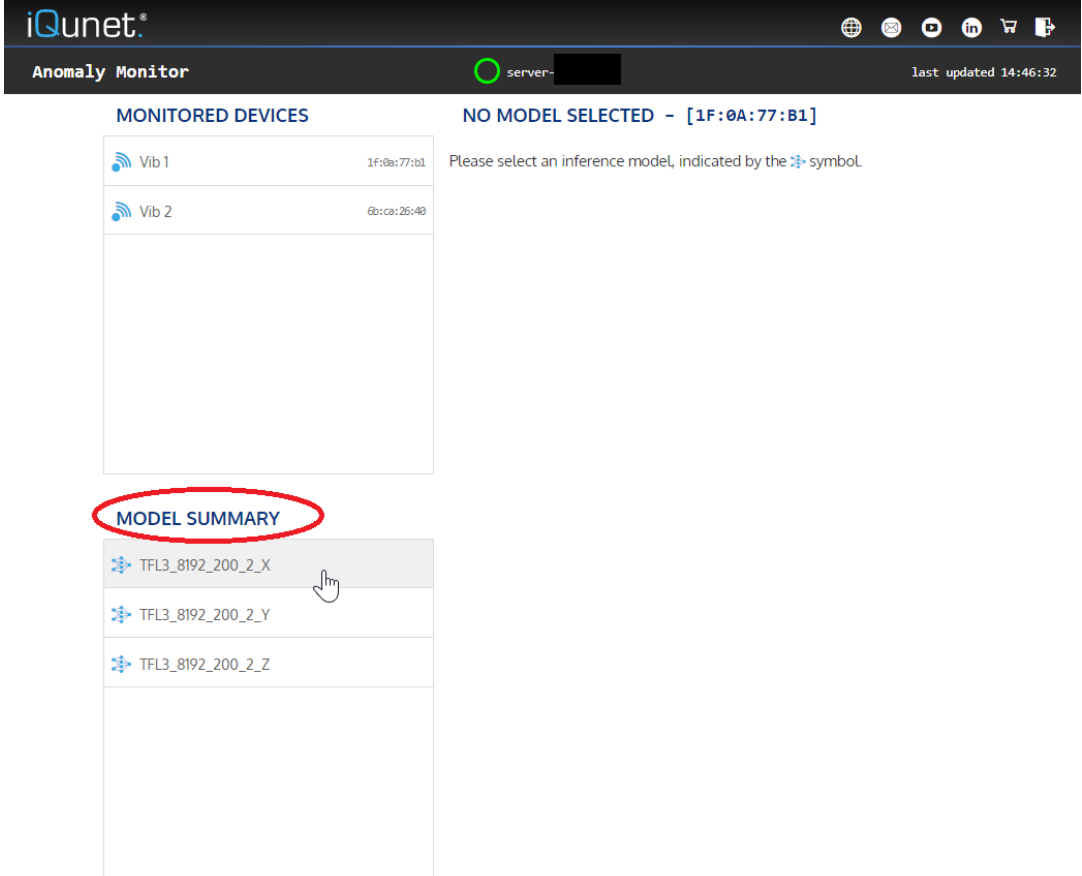

The screenshot displays the iQunet Anomaly Monitor web interface. At the top, the header includes the iQunet logo, a navigation bar with icons for home, settings, and other functions, and a status bar showing 'server-' and 'last updated 14:46:32'. Below the header, the main content area is divided into two columns. The left column, titled 'MONITORED DEVICES', lists two devices: 'Vib 1' with MAC address '1f:0a:77:b1' and 'Vib 2' with MAC address '6b:ca:26:4b'. The right column, titled 'NO MODEL SELECTED - [1F:0A:77:B1]', contains a message: 'Please select an inference model, indicated by the symbol.' Below these columns, the 'MODEL SUMMARY' section is highlighted with a red circle. It lists three models: 'TFL3_8192_200_2_X', 'TFL3_8192_200_2_Y', and 'TFL3_8192_200_2_Z'. A mouse cursor is shown hovering over the first model, 'TFL3_8192_200_2_X'.

USER MANUAL

Select or unselect an expectile by clicking on the colored lines.

Set an alarm level for the median prediction error.

Status of the last new measurement: alarm (median error above alarm level) or idle (median error below alarm level).

Open the model details to see which and how many parameters are used for the model training.

Status of the anomaly monitor: a new measurement is being processed if the status is not idle.

List of the highest prediction errors (peaks): BLUE colored items are raw anomalies below alarm level, RED colored items are above alarm level.

Clicking on 1 of these items shows where the anomaly is situated in the graph above and opens the time series in the vibration lab on the right-hand side.

You can compare the selected anomaly related measurement with measurements coming before and after that measurement. Check for 3D trends by adding them to the SPECTRUM box in the vibration lab (see figure below).




USER MANUAL



8. System settings

Open the “System Settings” panel by clicking on the “Config” symbol on the left-hand side in the iQunet Sensor Dashboard.

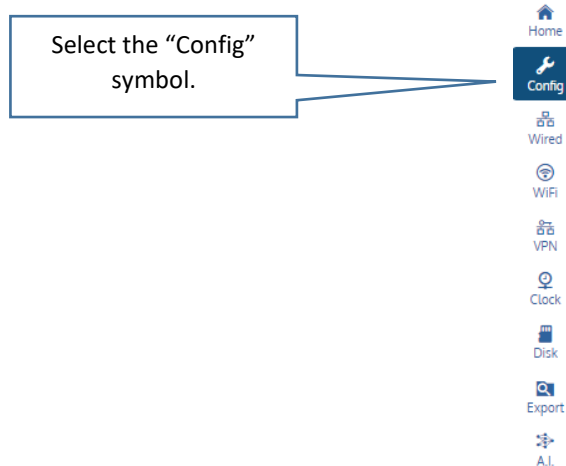

USER MANUAL

8.1. Suspend measurements

All Sensors: Suspend measurements.
If enabled, measurements on all sensors will be stopped. Resets to active at system reboot.



If the slider is set to active, all measurements on the complete connected devices list will be paused. Inactivating the slider will activate the measurements on all sensors.

Remark: the slider will be reset to active after a system reboot.

8.2. Lock DHCP Address Pool

Sensor Network: Lock DHCP Address Pool.
If locked, roaming devices will be denied access for the first 5 DHCP requests.



If the slider is set to locked, roaming sensor devices will be denied access to this iQunet Server for the first 5 DHCP requests. The sensor will still be allowed access but with a delay of approximately 15 seconds. In this way an accidental sensor reboot within the wireless sensor network of this Server will not be picked up.

After the 15 seconds delay the sensor will be accepted by the Server and listed as pending (blue color) in the "Connected Devices" list. After 10 minutes the sensor will be rebooted so it can reconnect itself to its original Base Station/Repeater and corresponding Server where it received a name previously. If it was the intention to connect the sensor to this Server, you must (re)name the sensor (see section 2.1).

Remark: it is recommended to leave the switch in the unlocked status in normal operation.

Remark: a sensor will always look for a Base Station or Repeater within its wireless range. In this way sensors cannot get "lost". If a sensor in blue "pending" status is not able to connect to a second Base Station or Repeater (with better connectivity and/or previously named there), it will remain connected to the Base Station or Repeater with the best connectivity (see section 1.2.1).

8.3. Reduce MTU size

Reduce the MTU size on the ham0 VPN interface.
Improves latency on some networks with packet fragmentation.



Reducing the MTU (Maximum Transmission Unit) size can improve the latency on some networks with packet fragmentation. The MTU size defines the largest packet size that can be transmitted as a single entity over the network connection (without fragmentation). If an IP packet is larger than the MTU size of the connection, the packet will be fragmented into smaller packets so that it fits within the network constraints. The MTU is usually limited by the underlying network capabilities. If the MTU is larger than the network can support, data will get lost.

A larger MTU value allows more data to be transferred at once and therefore reduces the overhead. On the other hand, smaller packets (smaller MTU sizes) can be transferred faster and reduce the network delay. Therefore, the MTU size should be adjusted to optimize both requirements for the specific network connection.